

INTERRA

Developer of Uniqueness

KNX Presence Sensors

Product Manual



Contents

1. CONTENT OF THE DOCUMENT	6
2. PRODUCT DESCRIPTION.....	7
2.1. <i>Technical Information</i>	<i>8</i>
2.2. <i>Detection Ranges</i>	<i>9</i>
2.3. <i>Connection Features</i>	<i>14</i>
2.4. <i>Dimensions.....</i>	<i>15</i>
2.5. <i>Functionality</i>	<i>16</i>
2.5.1. <i>Constant Light Switch</i>	<i>16</i>
2.5.2. <i>Constant Light Control</i>	<i>17</i>
3. ETS PARAMETERS & DESCRIPTIONS.....	18
3.1. <i>General Page.....</i>	<i>18</i>
3.1.1. <i>Parameters List</i>	<i>19</i>
3.2. <i>Brightness Detection.....</i>	<i>20</i>
3.2.1. <i>Parameters List.....</i>	<i>21</i>
3.3. <i>Sensor (Movement).....</i>	<i>23</i>
3.3.1. <i>Sensor Operation</i>	<i>23</i>
3.3.1.1. <i>Parameters List</i>	<i>24</i>
3.3.2. <i>Sensor Output</i>	<i>26</i>
3.3.2.1. <i>Parameters List</i>	<i>27</i>
3.3.3. <i>Sensor Lock</i>	<i>29</i>
3.3.3.1. <i>Parameters List</i>	<i>30</i>
3.4. <i>Presence Channel.....</i>	<i>31</i>
3.4.1. <i>Constant Light-Controller – Operation</i>	<i>31</i>
3.4.1.1. <i>Parameters List</i>	<i>32</i>
3.4.2. <i>Constant Light-Controller – Output.....</i>	<i>34</i>
3.4.2.1. <i>Parameters List</i>	<i>35</i>
3.4.3. <i>Constant Light-Controller – Input</i>	<i>36</i>
3.4.3.1. <i>Parameters List</i>	<i>37</i>
3.4.4. <i>Constant Light Controller – Lock.....</i>	<i>38</i>
3.4.4.1. <i>Parameters List</i>	<i>39</i>
3.4.5. <i>Constant Light-Controller – Forced Operation.....</i>	<i>40</i>
3.4.5.1. <i>Parameters List</i>	<i>41</i>
3.4.6. <i>Presence Channels Priority List</i>	<i>42</i>
3.5. <i>Inputs</i>	<i>43</i>
3.5.1. <i>Input – Switch Sensor.....</i>	<i>43</i>
3.5.1.1. <i>Parameters List</i>	<i>44</i>
3.5.2. <i>Input – Switch / Dimming Sensor.....</i>	<i>47</i>
3.5.2.1. <i>Parameters List</i>	<i>48</i>
3.5.3. <i>Input – Shutter Sensor</i>	<i>50</i>
3.5.3.1. <i>Parameters List</i>	<i>51</i>
3.5.3.2. <i>The Functionality of Each Function</i>	<i>55</i>
3.5.4. <i>Input Value / Forced Operation</i>	<i>57</i>

3.5.4.1. Parameters List	58
3.5.5. <i>Input – Control Scene</i>	60
3.5.5.1. Parameters List	61
3.5.6. <i>Input – RGB Colour Control</i>	63
3.5.6.1. Parameters List	64
3.5.7. <i>Input – Mode Selection</i>	66
3.5.7.1. Parameters List	67
3.5.8. <i>Input – Additional Probe</i>	69
3.5.8.1. Parameters List	70
3.6. Temperature	72
3.6.1. <i>Temperature Info</i>	72
3.6.1.1. Parameters List	73
3.7. Virtual Card Holder	75
3.7.1. <i>Virtual Card Holder – General</i>	75
3.7.1.1. Parameters List	76
3.7.2. <i>Virtual Card Holder – Output</i>	77
3.7.2.1. Parameters List	78
3.7.3. <i>Virtual Card Holder – Internal Inputs</i>	80
3.7.3.1. Parameters List	81
3.7.4. <i>Virtual Card Holder – Remote Input</i>	82
3.7.4.1. Parameters List	83
3.8. Logic Functions	84
3.8.1. <i>Logic Functions – General</i>	84
3.8.1.1. Parameters List	85
3.8.2. <i>Logic Functions - Input</i>	86
3.8.2.1. Parameters List	87
3.8.3. <i>Logic Functions – Output General</i>	91
3.8.3.1. Parameters List	92
3.8.4. <i>Logic Functions – Outputs 1-5</i>	93
3.8.4.1. Parameters List	94
3.8.5. <i>Logic Functions – Lock</i>	96
3.8.5.1. Parameters List	97
4. ETS OBJECTS LIST & DESCRIPTIONS	98
4.1. <i>General Objects</i>	103
4.2. <i>Brightness Objects</i>	104
4.3. <i>Sensor</i>	105
4.4. <i>Presence</i>	108
4.5. <i>Inputs</i>	113
4.6. <i>Temperature</i>	115
4.7. <i>Virtual Card Holder</i>	116
4.8. <i>Logic Function</i>	118

Information contained in this publication regarding device applications and the like is provided only for your convenience and may be superseded versions by updates. It is your responsibility to ensure that your application meets your specifications.

INTERRA MAKES NO REPRESENTATIONS OR WARRANTIES OF ANY KIND WHETHER EXPRESS OR IMPLIED, WRITTEN OR ORAL, STATUTORY OR NONSTATUTORY, RELATED TO THE INFORMATION INCLUDING BUT NOT LIMITED TO ITS CONDITION, QUALITY, PERFORMANCE, MERCHANTABILITY OR FITNESS FOR PURPOSE.

Interra disclaims all liability arising from this information and its use. Use of Interra devices in life support and/or safety applications is entirely at the buyer's risk, and the buyer agrees to defend, indemnify and hold harmless Interra from any damages, claims, suits, or expenses resulting from such use. No licenses are conveyed, implicitly or otherwise under any Interra intellectual rights.

Trademarks

The Interra name, logo and the Interra ITR415 - XXXX KNX Presence Sensor devices are registered trademarks of Interra Technology in Turkey and other countries.

All other trademarks mentioned herein are property of the Interra Technology.

© 2022, Interra, Printed in Turkey, All Rights Reserved.



Printed on recycled paper.

TS EN ISO 9001:2008

TO OUR CUSTOMERS

One of our most important aims is to provide you with the best documentation possible to use successfully your Interra products. Focusing on this, we will keep on improving our documentation to better suit your needs. Our publications will be updated as new volumes as soon as changes are introduced.

If you have any questions or comments regarding this publication, do not hesitate to contact us:

E-mail: info@interra.com.tr

Tel: +90 (216) 326 26 40 Fax: +90 (216) 324 25 03

Most Current Product Manual

To obtain the most up-to-date version of this product manual, please visit our Web site at:

<http://www.interratechnology.com>

You can determine the version of an Interra document by examining its literature number found on the bottom right corner of any page.

The first two letters of the literature are the type of document. The numbers that follow are the creation date of the document and the last letter is the version (e.g., PM181017001A is the version A of a product manual created on the date 17/10/18).

1. Content of The Document

This document contains Interra ITR415-XXXX coded KNX Presence Sensor devices' electronic and all essential feature information for programming the products. In each subtitle is explained the characteristics of the device. Modifications of the product and special change requests are only allowed in coordination with product management.

This manual provides detailed technical information concerning ITR415-XXX1 Mid-Range KNX Presence Sensor, ITR415-XXX2 Mid-Range Plus KNX Presence Sensor, ITR415-XXX3 Wide-Range KNX Presence Sensor, ITR415-XXX4 High Bay KNX Sensor and ITR415-XXX5 High Bay Plus KNX Sensor. All the models have the same software functionality so, the features described in this document apply to all versions.

This user manual is intended for use by KNX installers and describes the functions and parameters of the Interra KNX presence sensor family devices and how it is possible to change the settings and configurations using the ETS software tool. This document also describes the installation, programming, commissioning and use of the devices with detailed information.

2. Product Description

ITR415-XXXX series KNX Presence Sensor devices are the newest products of Interra Technology. The Interra KNX Presence detectors are designed for using at mainly in interior areas of buildings.

The range of Interra presence sensors is suitable for ceiling mounting and with flush mount or surface mount optionality.

Interra KNX presence sensors support presence detection, brightness detection, movement detection, temperature detection and external temperature detection.

All versions have a rear connector with 3 digital inputs that can be connected to buttons and used for switch sensor, switch/dimming sensor, shutter sensor, value/forced operation, scene control, RGB colour control and HVAC mode selection control.

Temperature measuring through an integrated sensor, analog input, KNX temperature sensor with the possibility of sending the value on change and periodically to the bus for monitoring the room temperature.

Interra KNX presence sensors have 5 logic function blocks and can be set the logical relation AND/OR/XOR. Each block can control 5 output objects.

2.1. Technical Information

The following table shows the technical information of the KNX Sensors.

Product Name	Mid-Range	Mid-Range Plus	Wide-Range	High Bay	High Bay Plus
Product Code	ITR415-XXX1	ITR415-XXX2	ITR415-XXX3	ITR415-XXX4	ITR415-XXX5
Power Supply	21..30 V DC	21..30 V DC	21..30 V DC	21..30 V DC	21..30 V DC
Current Consumption	5 mA	5 mA	5 mA	5 mA	5 mA
Brightness Detection	1-1200 lux	1-1200 lux	1-1200 lux	1-1200 lux	1-1200 lux
Number of Detectors	1	3	3	3	3
Inputs	2 x Digital 1 x Analog	2 x Digital 1 x Analog	2 x Digital 1 x Analog	2 x Digital 1 x Analog	2 x Digital 1 x Analog
Number of Channels	4 x Presence 1 x Brightness 5 x Logic	4 x Presence 1 x Brightness 5 x Logic	4 x Presence 1 x Brightness 5 x Logic	4 x Presence 1 x Brightness 5 x Logic	4 x Presence 1 x Brightness 5 x Logic
Maximum Air Humidity	%90 RH	%90 RH	%90 RH	%90 RH	%90 RH
Pollution Degree	2	2	2	2	2
Type of Protection	Flush : IP 20 Surface : IP 44	Flush : IP 20 Surface : IP 44	Flush : IP 20 Surface : IP 44	Flush : IP 20 Surface : IP 44	Flush : IP 20 Surface : IP 44
Operation Temperature	-5°C...45°C	-5°C...45°C	-5°C...45°C	-5°C...45°C	-5°C...45°C
Storage Temperature	-10°C...60°C	-10°C...60°C	-10°C...60°C	-10°C...60°C	-10°C...60°C
Dimensions	70 × 41,8 mm (Φ x H)	70 × 41,8 mm (Φ x H)	70 × 41,8 mm (Φ x H)	70 × 48 mm (Φ x H)	70 × 48 mm (Φ x H)

2.2. Detection Ranges

This section provides information about the detection ranges of Interra presence sensor family devices. The motion detection ranges of each different model vary depending on the installation height. Therefore, detection distances should be carefully examined, and device installations should be made by these distances.

Mid-Range KNX Presence Sensor:

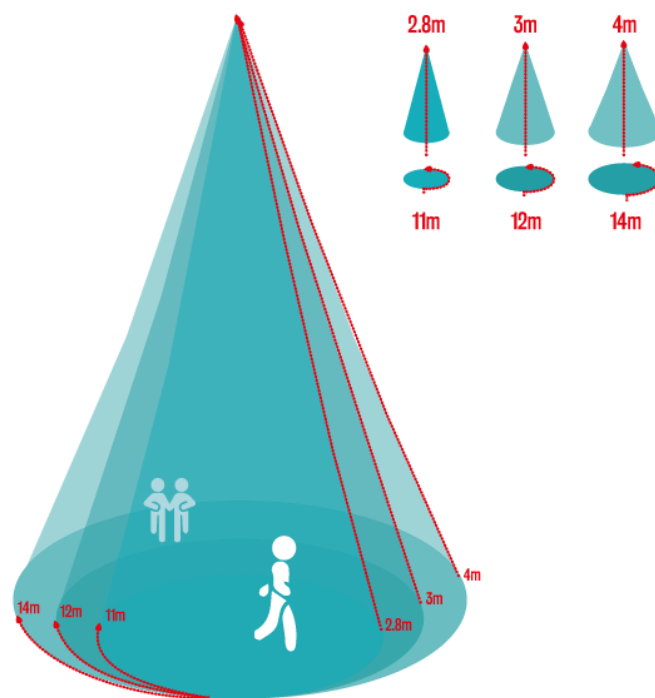


Fig. 1 : Mid-Range KNX Presence Sensor Detection Range

Mounting Height	Seated Activity	Walking Towards	Walking Across
2.8 m	5.5 m	6 m	11 m
3 m	6 m	7 m	12 m
4 m	7 m	8 m	14 m

Mid Range Plus KNX Presence Sensor:

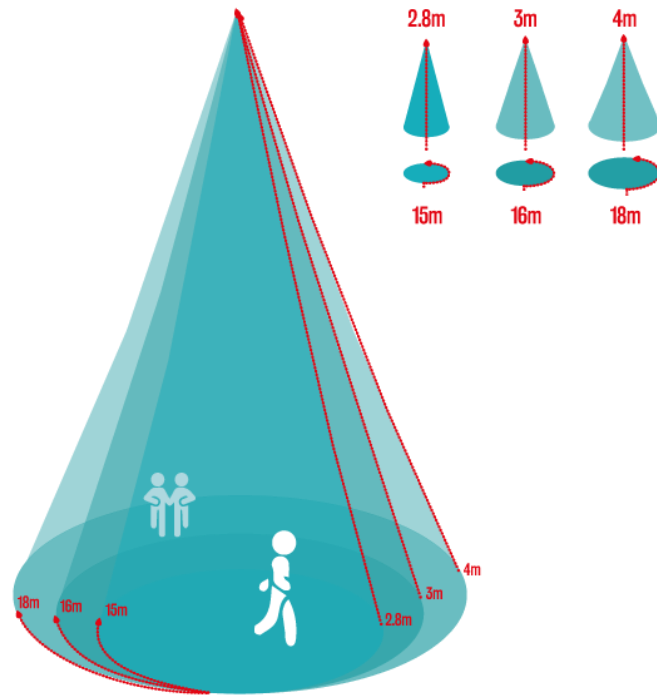


Fig. 2 : Mid Range Plus KNX Presence Sensor Detection Range

Mounting Height	Seated Activity	Walking Towards	Walking Across
2.8 m	6 m	9 m	15 m
3 m	6.5 m	11 m	16 m
4 m	7 m	12 m	18 m

Wide Range KNX Presence Sensor:

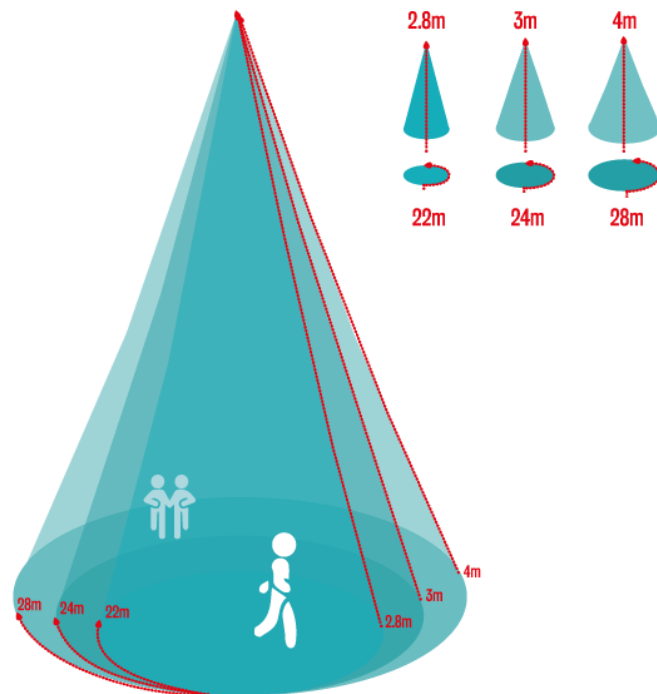


Fig. 3 : Wide Range KNX Presence Sensor Detection Range

Mounting Height	Seated Activity	Walking Towards	Walking Across
2.8 m	6 m	12 m	22 m
3 m	7 m	14 m	24 m
4 m	7.5 m	16 m	28 m

High Bay KNX Sensor:

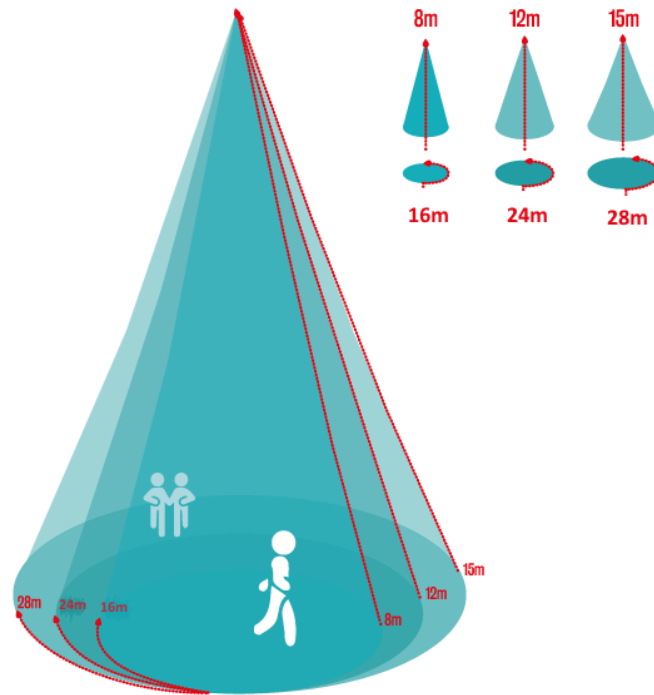


Fig. 4 : High Bay KNX Sensor Detection Range

Mounting Height	Walking Across
4 m	8 m
8 m	16 m
12 m	24 m
15 m	28 m

High Bay Plus KNX Sensor:

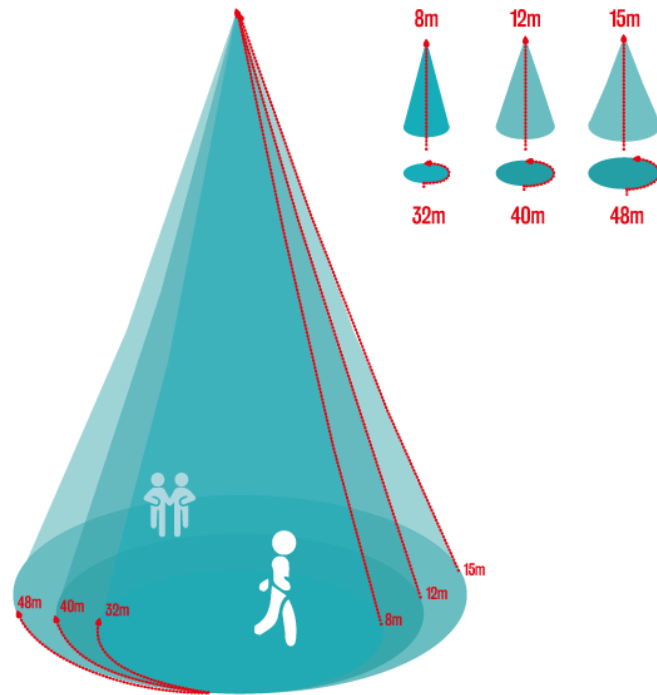


Fig. 5 : High Bay Plus KNX Sensor Detection Range

Mounting Height	Walking Across
4 m	16 m
8 m	32 m
12 m	40 m
15 m	48 m

2.3. Connection Features

The figure below shows the KNX Presence Sensor connectors. All of the ITR415-XXXX models have the same connection layout.

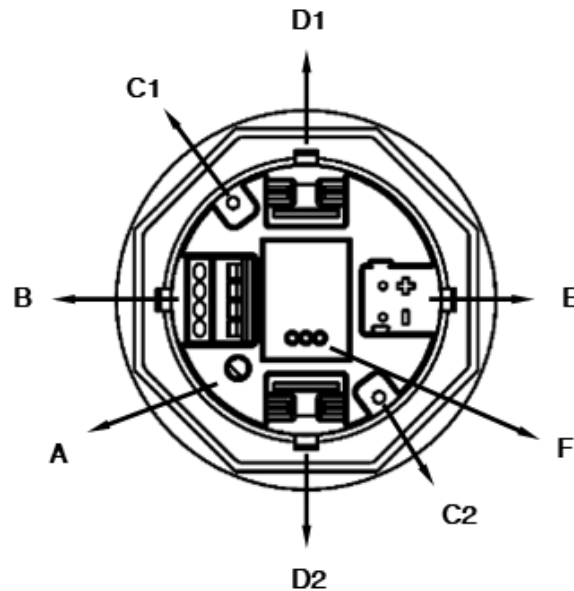



Fig. 6 : Connection Features of KNX Presence Sensor

Letter	Feature
A	KNX Programming Button
B	1 x Analog, 2 x Digital Input
C1	Metal Tab for Junction Box
C2	Metal Tab for Junction Box
D1	Metal Spring
D2	Metal Spring
E	KNX Connector
F	Programming connector


2.4. Dimensions

All values given in the device dimensions are millimetres. Interra KNX Presence Sensors can be used as flush mount or surface mount.

Flush Mounted :

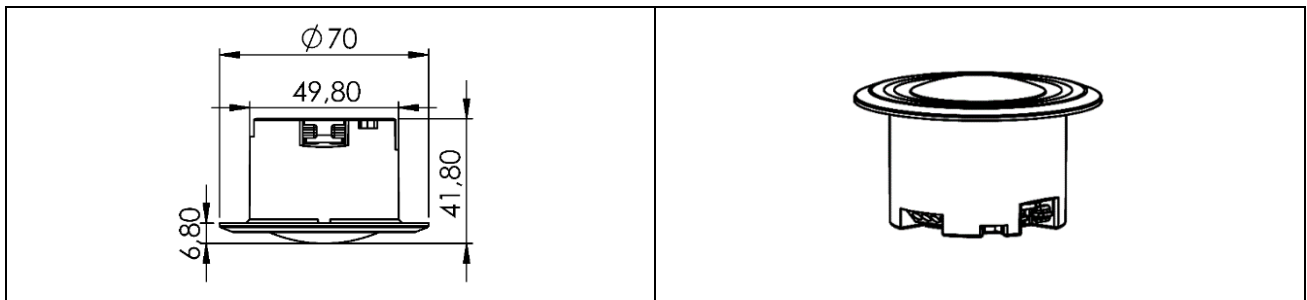

Surface Mounted :

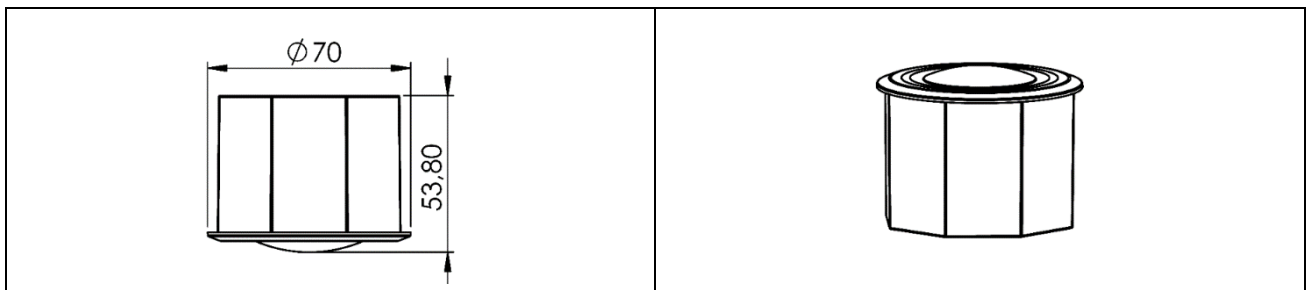

2.5. Functionality

All the Interra KNX Presence Sensors offer various options to ensure that the brightness in the room is maintained at a more pleasant level. To ensure this, constant light switch and constant light control functions are mostly used. There is a difference between the functions of the constant light switch and the constant light controller. Both functions ensure that the brightness does not drop below a certain level when persons are in the room. The use of a presence detector is especially practical for work stations in an office since even small movements are detected.

2.5.1. Constant Light Switch

The constant light switch switches on lamps in the room as soon as movement of a person is detected and the desired brightness value is not attained by entering daylight alone. The programmed setpoint minus hysteresis is maintained as long as people are in the detection range. The application detects when entering daylight is sufficient. The lamps are then switched off again to save energy.

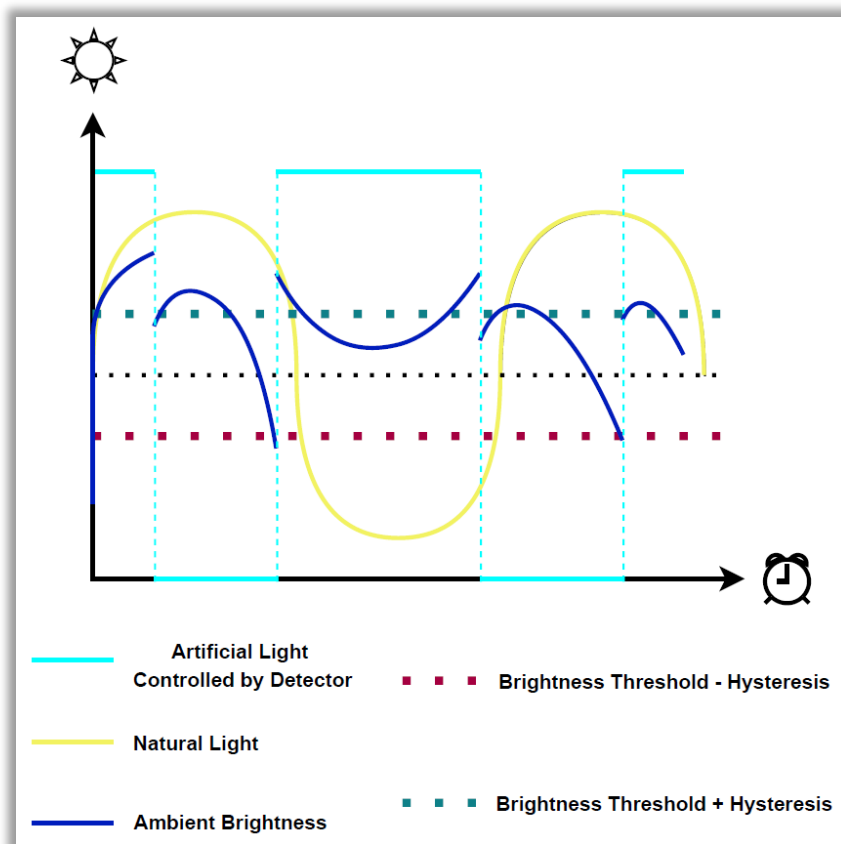


Fig. 7 : Constant Light Switch Operation

2.5.2. Constant Light Control

In contrast to the constant light switch, there is the possibility of switching in several stages. Both the constant light controller and the constant light switch ensure that the level of brightness in the room does not drop below the desired level. However, the brightness controller is additionally able to send telegrams for dimming lamps to the KNX bus. This enables a constant level to be attained due to the dimming of lights brighter and darker, always in dependence on the natural light in the room. And the accuracy of the control increases with the operating time.

The KNX Presence Sensors can operate either in "Automatic" or "Automatic switch-off" mode in the Constant Light Control application. If an automatic switch-off is selected, for example, the light must be switched on manually via a control element. The light remains on as long as movement is detected and daylight is not sufficient. If no movement is detected, the light-on time delay expires. Only then is an OFF telegram sent to the bus via the output. In automatic mode, the movement sensor also takes over the switch-on function as soon as someone enters the room.

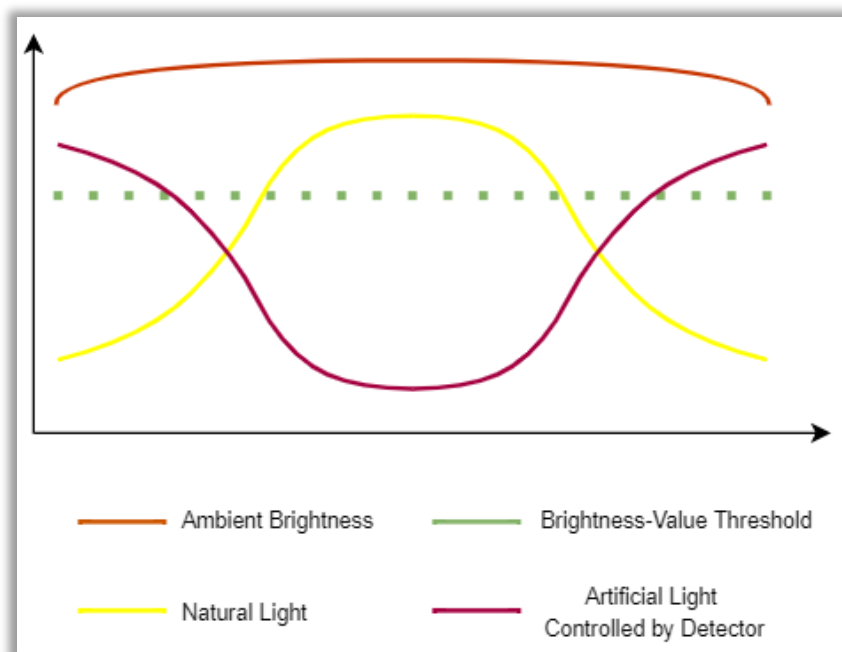


Fig. 8 : Constant Light Control Operation

3.1.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Delay time after voltage return	This parameter is used to determine the delay time after voltage return in seconds. When in a delayed state, the KNX Presence Sensor does not send any KNX telegrams. Incoming telegrams are received and updated in the background. The updated values are only executed when the wait state ends and then sent according to the parametrization.	2...60
Enable Virtual Card Holder	This parameter is used to enable the virtual card hold of the KNX Presence Sensor. If this parameter is activated, a separate parameter page will be opened for configuration.	No Yes
Use object for LED	This parameter is used to activate or deactivate the use of LED indicator KNX object during presence detection.	No Yes
-> LED indicator for the presence event	This parameter is used to give status information via the blue LED when motion is detected by the KNX presence sensor. always off: The blue LED will be off continuously. on when movement detected: The blue LED turn on when there is a motion detected by the sensor.	Always off On when movement detect
Enable In Operation	This parameter is used to determine the existence of the KNX Presence Sensor on the KNX bus line. The cyclic telegram can be monitored by an external KNX device. If a telegram is not received, the device may be defective or the KNX cable to the transmitting device may be interrupted. Yes: The group object is enabled. No: The group object is not enabled.	No yes
-> In operation send	This parameter is used to determine the send value of the "General - In operation" group object on the KNX bus line.	Value '0' Value '1'
-> In operation send interval (min)	This parameter is used to set the cyclically sending time interval value of the "General - In operation" group object.	1...5...255
Enable Movement Sensor Objects	This parameter is used to enable or disable each integrated presence detectors to send the detected movements to the KNX bus.	No Yes

3.2. Brightness Detection

On this parameter page, brightness functionality related configurations are made. Brightness calibration type, brightness measurement algorithm and brightness variation features can be configured on this page.

The screenshot shows the configuration interface for the Brightness Detection feature. On the left, a sidebar menu lists various settings: General, Brightness Detection (selected), Brightness, Sensor (Movement), Presence Channels, Inputs, Temperature, and Logic Functions. The main content area displays the following configuration options:

- Indirect measuring method of internal sensor calibrate by user
- Brightness source: internal probe
- Average brightness algorithm: very fast
- Enable "Measured value" object: no yes
- Calibration type: via object with adjustment value
- Brightness compensation value: 0 lux

Fig. 10 : Brightness Page Configuration

3.2.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Calibration type	<p>This parameter is used to determine the brightness sensor calibration method. Brightness calibration must be done after the sensor installation, for the sensor to measure correctly and therefore work ideally with other sensor features.</p> <p>Via object : Calibration is made through the KNX communication object. The brightness value measured with lux meter from a point in the sensing range of the sensor (usually just below the location where the sensor is installed) should be written into the KNX calibration object as a new lux value.</p> <p>With adjustment value : Calibration is made through the brightness compensation value parameter.</p>	<p>via object with adjustment value</p>
-> Brightness compensation value	<p>This parameter is used to determine the brightness compensation value. The entered value is subtracted from the value measured by the sensor or added.</p> <p>Ex : The ambient brightness value measured by the sensor is 175 lux. Moreover, with a lux meter, the measured ambient brightness value is 200 lux. In this case, the sensor measures the ambient brightness value 25 lux less. For the sensor to measure accurately, the value 25 should be entered in the brightness compensation value parameter.</p>	-200...0...200
Average brightness algorithm	<p>This parameter is used to define the response speed of the controlled output after a measured ambient brightness variation. It defines the calculation speed of the average illuminance value, the faster the algorithm and the faster it reacts to a change in lux level. The "very fast" selection can lead to very frequent switching on and off of the light, the "very slow" selection can introduce delays in switching the light on or off.</p>	<p>very fast fast normal slow very slow</p>

Enable “Measured Value” Object	<p>This parameter is used to enable or disable the measured value object. The measured brightness value can be sent to the KNX bus via this object.</p>	No Yes
Sending on variation	<p>This parameter is used to determine whether it will be sent to the bus line depending on the change of the ambient brightness value.</p> <p>do not send: The brightness value is never sent to the KNX bus line.</p> <p>xx lux: If there is a change from the last measured lux value equal to the lux value entered in the parameter, the new measured lux value is sent to the KNX bus line.</p> <p>Note : xx means the listed values in the parameter list such as 10 lux, 20 lux, 5 lux etc.</p>	Do not send 5 lux, 10 lux, 15 lux, 20 lux, 25 lux, 30 lux, 35 lux, 40 lux, 45 lux, 50 lux, 55 lux, 60 lux, 65 lux, 70 lux, 75 lux
Cyclic sending of brightness	<p>This parameter is used to determine the periodic transmission time of the brightness value to the KNX bus line. The values entered are in hours, minutes and seconds.</p>	00:00:05... 00:00:30 ...18:12:15

3.3. Sensor (Movement)

This section describes the parameters for how to use the sensor channel. Since the sensor channel has many features for basic uses in general, it has a simpler parametric structure compared to presence channels. Without the need to configure the presence channels, many basic needs can be set up by simply configuring the sensor channel.

If desired, presence channels can be used for environments with more complex user demands.

3.3.1. Sensor Operation

On this parameter subpage, the basic parameters required for sensor operation are explained in detail. Parameters such as master/slave, motion detection source, brightness level source, light-on time etc. are configured in this section.

General	Operation type	<input checked="" type="radio"/> master mode	<input type="radio"/> slave mode
– Brightness Detection	Used movement detection	<input checked="" type="radio"/> internal only	<input type="radio"/> internal and external
Brightness	Detection independent of brightness	<input type="radio"/> no	<input checked="" type="radio"/> yes
– Sensor (Movement)	Light on time	<input type="text" value="00:05:00"/>	hh:mm:ss
Operation	Light on time change via object	<input checked="" type="radio"/> no	<input type="radio"/> yes
Output	Safety time	<input type="text" value="01.250"/>	ss.fff
Lock			
+ Presence Channels			
+ Inputs			
+ Temperature			
+ Logic Functions			

Fig. 11 : Sensor - Operation Page Configuration

3.3.1.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Operation type	<p>This parameter is used to determine the operating mode of the sensor. Operation mode is set as master or slave mode.</p> <p>In slave mode, the device can only send periodic ON telegrams depending on motion detection. In slave mode, sensor features can be used in a limited way.</p> <p>In master mode, in addition to motion detection, ON or OFF telegrams can be sent depending on the brightness if desired. Also, unlike slave mode, all features can be used in master mode.</p>	master mode slave mode
Used movement detection	<p>This parameter is used to determine the type of source that will be used for motion detection. There are 2 types of motion detection sources:</p> <p>Internal only : Motion detection is made only with the built-in detectors inside the sensor.</p> <p>Internal and external : Motion detection is done both by the internal detectors inside the sensor and by an external source (slave sensor, a button used for presence).</p>	Internal only Internal and external
Detection independent of brightness	<p>This parameter is used to determine whether the motion detection performed by the sensor should be independent of the ambient brightness.</p>	no yes
-> Used brightness	<p>This parameter is used to determine the source to be used for measuring the ambient brightness value. There are 2 types of brightness detection sources.</p> <p>Internal: It is the internal source of brightness. Ambient brightness is measured with the built-in brightness sensor on the sensor.</p> <p>External: It is an external source of brightness. Ambient brightness is determined by sending data from a device that can measure brightness to the relevant KNX object of the sensor.</p>	internal external
-> Brightness-value threshold	<p>This parameter is used to specify the lux value at which the sensor is to start to respond. If the detector detects a movement and the measured brightness</p>	1...400...1200

	lies above the threshold, no telegram is sent during movement.	
-> Threshold change via object	<p>This parameter is used to change the brightness threshold value via a KNX object.</p> <p>The value is sent to this object in lux. Object type is a 2-byte float.</p>	<p>no</p> <p>yes</p>
-> Hysteresis	<p>This parameter is used to determine the hysteresis value. The hysteresis is a percentage value (+/-) that is related to the setpoint in lux. The hysteresis is a tolerance for maintaining the setpoint. The pre-setpoint is sufficient for most applications.</p> <p>Switching threshold = brightness threshold ± hysteresis</p> <p>The hysteresis prevents excessive switching when the current ambient brightness is close to the brightness threshold.</p>	15... 60 ...500
Light on time	<p>This parameter is the time between the last movement detected and the sending of the telegram "value for switch-off" by the sensor.</p> <p>The presence detector will switch off the lamps in the room if no movement is detected. A light-on time delay can be set to prevent the lamp from being switched off immediately. This time starts as soon as at the end of motion. If movement is detected again within this period, the light-on time delay is reset.</p>	00:00:10... 00:05:00 ...18:12:15
Light on time change via object	<p>This parameter is used to change the light-on time duration via a KNX object. The time entered is in seconds.</p> <p>Note : The values which can be sent are between 10 and 65535 seconds. If a value that is too small or too large is sent, the value is automatically adjusted to the limit value.</p>	<p>no</p> <p>yes</p>
Safety time	<p>This parameter is used to determine the time it takes the detector to perform the detection process again after the light on time has expired. The safety time is started after the detector has been switched off due to the expiry of light on time. The main purpose of safety time is to prevent immediate reactivation.</p>	00.100... 01.250 ... 59.999

3.3.2. Sensor Output

On this parameter subpage, the sensor channel output related parameters are described. The relevant parameters that need to be configured to control the ambient brightness through the switching are explained. The switching operation for the movement channel is performed over the output object of the presence detector.

General	Output object send at	switching on/off
– Brightness Detection	Output is of type	<input checked="" type="radio"/> 1-bit <input type="radio"/> 1-byte
Brightness	Begin of Motion	
– Sensor (Movement)	Value for switch on	<input type="radio"/> OFF '0' <input checked="" type="radio"/> ON '1'
Operation	Sending value for switch-on cyclic	<input checked="" type="radio"/> no <input type="radio"/> yes
Output	End of Motion	
Lock	Value for switch off	<input checked="" type="radio"/> OFF '0' <input type="radio"/> ON '1'
+ Presence Channels	Sending value for switch-off cyclic	<input checked="" type="radio"/> no <input type="radio"/> yes
+ Inputs		
+ Temperature		
+ Logic Functions		

Fig. 12 : Sensor - Output Page Configuration

3.3.2.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Output is of type	This parameter is used to determine the output type. Output type can be set as 1-bit or 1-byte.	1-bit 1-byte
(Begin of Motion) Value for switch-on	This parameter is used to determine the switch on the value that will be sent to the KNX bus line when the presence detection is over. 2 types of data are sent according to the output type. 1-byte : The value between 0% and 100% is sent. 1-bit : OFF or ON value is sent.	100% (255) , 99% (252), 98% (250).... 3% (8), 2% (5), 1% (3)
Sending value for switch-on cyclic	This parameter is used to determine whether the switch on value will be sent to the KNX bus periodically. If the parameter value is selected as "yes", the switch on value will be sent periodically.	no yes
(End of Motion) Used three-stage off (*)	This parameter is used by the sensor to switch off with 3 different level transitions after the end of motion. The parameters related to this feature are explained in detail in the table below.	no yes
Value for switch off	This parameter is used to determine the switch off the value that will be sent to the KNX bus line when the presence detection is over. 2 types of data are sent according to the output type. 1-byte : The value between 0% and 100% is sent. 1-bit : OFF or ON value is sent.	1 byte : 100% (255), 99% (252), 98% (250).... 3% (8), 2% (5), 1% (3), 0% (OFF) 1 bit : OFF '0' ON '1'
Sending value for switch-off cyclic	This parameter is used to determine whether the switch off value will be sent to the KNX bus periodically. If the parameter value is selected as "yes", the switch-off value will be sent periodically.	no yes

Cyclical repeating time	This parameter is used to send the switch on and switch off values periodically. The time information to be entered is in hours, minutes and seconds.	00:00:10...00:00:30 ...18:12:15
--------------------------------	---	------------------------------------

(*) Three Stage Off

State : It indicates 3 different transition states as A, B and C. When the presence information is no longer detected by the sensor, after the light-on time has elapsed, the sensor will first switch to state A. When the stay at A time has elapsed, it switches to state B. When the stay B time has elapsed, it switches to state C. After the time entered in state C has expired, the sensor sends the switch off value.

Stay Time : This parameter is used to set the transition times of states A, B and C. Time information is configured by entering hours, minutes and seconds.

Value : This parameter is used to adjust the ambient light level in states A, B and C. It is configured by selecting one of the percentage values in the parameter list.

State	Stay Time	Value
Stage A	00:00:05...00:00:30...18:12:15	100% (255), 99% (252), 98% (250)...3% (8), 2% (5), 1% (3), 0% (OFF)
Stage B	00:00:05...00:00:30...18:12:15	100% (255), 99% (252), 98% (250)...3% (8), 2% (5), 1% (3), 0% (OFF)
Stage C	00:00:05...00:00:30...18:12:15	100% (255), 99% (252), 98% (250)...3% (8), 2% (5), 1% (3), 0% (OFF)

3.3.3. Sensor Lock

On the sensor lock parameter page, there are features for the sensor to be locked in various situations. In various cases, users can lock the sensor depending on their wishes and keep the brightness of the lighting devices connected to the sensor output at a certain level.

Special Note



Lock functionality is available separately for the Sensor channel and all Presence channels. For this reason, the lock functionality mentioned in this section is only related to the "Sensor" parameter page.

Special Note



The parametric structure of the lock function is the same as the lock functionality in Presence channels. For this reason, lock parameters are not explained again in the relevant sections.

General	Use sensor lock	<input type="radio"/> no <input checked="" type="radio"/> yes
– Brightness Detection	Telegram for lock activation	<input type="radio"/> ON telegram <input checked="" type="radio"/> OFF telegram
Brightness	Output behavior when lock	<input type="radio"/> only lock <input checked="" type="radio"/> lock and transmit value
– Sensor (Movement)	Output value	<input type="radio"/> OFF '0' <input checked="" type="radio"/> ON '1'
Operation	Automatic unlock after delay	<input type="radio"/> no <input checked="" type="radio"/> yes
Output	Automatic unlock time	<input type="text" value="00:00:30"/> hh:mm:ss
Lock		
+ Presence Channels		
+ Inputs		
+ Temperature		
+ Logic Functions		

Fig. 13 : Sensor - Lock Page Configuration

3.3.3.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Use sensor lock	This parameter is used to activate or deactivate the sensor lock feature. When this parameter is selected as "yes", parameters related to the locking feature will be visible on the page.	no yes
Telegram for lock activation	This parameter specifies the telegram value that should be used to lock the sensor. For example, if this parameter is selected as "ON telegram", the sensor will be locked when an ON telegram is sent from the KNX bus line to the relevant Lock object. In this state, when the OFF telegram is sent, the sensor lock will be removed. The opposite of this configuration is also valid.	ON telegram OFF telegram
Output behaviour when lock	This parameter is used to determine how the output behaviour will be when the sensor is locked.	only lock lock and transmit value
-> Output value	This parameter is used to determine the value to be sent to the KNX bus through the output object when the sensor is locked.	100% (255), 99% (252), 98% (250)... 3% (8), 2% (5), 1% (3), 0% (OFF)
Automatic unlock after delay	This parameter is used to activate or deactivate the feature of automatically unlocking the sensor after a certain period.	no yes
-> Automatic unlock time	This parameter is used to determine the time required to unlock the sensor from the moment the sensor is locked. The time information to be entered is in hours, minutes and seconds.	00:00:10... 00:00:30 ...18:12:15

3.4. Presence Channel

KNX presence sensors have 4 different presence channels for controlling the relevant environment based on the presence and/or brightness. These presence channels can be configured independently of each other.

There are 2 main functions in the presence channels. These:

- Constant Light Switch
- Constant Light Controller

The constant light switch is the same as the 'sensor' channel. Therefore, the explanations for the parameters are not made in this section. For detailed information about the parameters, see the "sensor" page. Detailed parameter descriptions for the use of constant light control are explained in this section, in 5 different subsections.

3.4.1. Constant Light-Controller – Operation

On this parameter subpage, the basic parameters required for constant light control are explained in detail. Since the presence channels are the same, only the parameters related to the presence 1 channel are explained. When other channels are used, this section can be referenced for the relevant presence channel.

Fig. 14 : Constant Light-Controller - Operation Page Configuration

3.4.1.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Application	<p>This parameter is used to determine the presence of channel functionality.</p> <p>Inactive: The presence channel is disabled.</p> <p>Constant light switch: The presence channel application is selected as the constant light switch.</p> <p>Constant light control: The presence channel application is selected as constant light control.</p>	<p>Inactive</p> <p>constant light switch</p> <p>constant light control</p>
Presence depending	<p>This parameter is used to determine whether constant light control will be performed based on presence.</p>	<p>no</p> <p>yes</p>
- > Operation mode	<p>This parameter is used to determine the operating mode of constant light control based on presence.</p> <p>Automatic: Automatic switch-on and automatic switch-off.</p> <p>In "Automatic" mode, in case it is too dark, the presence detector switches on automatically when detecting a movement. The switch off is affected when the set light-on time delay is expired.</p> <p>Automatic Switch Off: Manual switch-on and automatic switch off.</p> <p>In "Automatic switch-off" mode, the presence detector must be switched on manually using the manual control objects ('Absolute dimming', 'Relative dimming' etc.). The switch-off is affected automatically under consideration of the light-on time delay.</p>	<p>automatic</p> <p>automatic switch off</p>
Setpoint brightness value	<p>This parameter is used to set the desired brightness of the room. Below this threshold - hysteresis the presence detector switched at movement. The presence detector switches off again when the measured brightness is above the brightness-value threshold + hysteresis.</p>	<p>1...400...1200</p>
Setpoint change by bus	<p>This parameter is used to enable or disable the brightness-value threshold object.</p>	<p>no</p> <p>yes</p>

	This object can be used to change the switching threshold of the presence sensor. The value is sent to this object in lux.	
Hysteresis	<p>This parameter is used to determine the hysteresis value. By hysteresis value, the switching threshold of the KNX presence sensor is configured.</p> <p>Switching threshold = brightness threshold ± hysteresis</p> <p>The hysteresis prevents excessive switching when the current ambient brightness is close to the brightness threshold.</p>	15...100...500
Used brightness	<p>This parameter is used to specify the source to be used for ambient brightness measurement.</p> <p>Internal: Built-in brightness measurement sensor is used for brightness measurement</p> <p>External: The brightness values are received from an external source via the KNX bus line.</p>	internal external
Used movement detection	<p>This parameter is used to specify the source to be used for movement detection.</p> <p>Internal only: Built-in movement measurement sensor is used for movement detection.</p> <p>Internal and external: Both internal movement detection sensor and external movement detection source (such as another KNX presence sensor configured as a slave) are used.</p>	Internal only Internal and external
Light on time	<p>This parameter is the period between the last movement detected and the sending of the telegram "value for switch-off" by the sensor.</p> <p>The presence detector will switch off or dim the lamps in the room if no movement is detected. A light-on time delay can be set to prevent the lamp from being switched off immediately. This time starts as soon as at the end of motion. If movement is detected again within this period, the light-on time delay is reset.</p>	00:00:10...00:05:00 ...18:12:15
Enable forced operation	This parameter is used to enable or disable the forced operation feature of the KNX presence sensor.	no yes

3.4.2. Constant Light-Controller – Output

On this parameter subpage, the relevant parameters that need to be configured to control the ambient brightness through the dimming are explained. The dimming operation for the selected presence channel is performed over the output object of the presence detector. For this reason, separate parameter settings should be made for each presence channel to be used.

General	Brightness dim settings	
+ Brightness Detection	Dimming time for brightness from %0...%100	10:00 <input type="text"/> dd:iss
+ Sensor (Movement)	Dimming step size brighter	2 <input type="text"/>
- Presence Channels	Dimming step size darker	2 <input type="text"/>
- Presence 1	Maximum dimming value limit	100% (255) <input type="text"/>
Output	Minimum dimming value limit	0% (OFF) <input type="text"/>
Input	First dimming value after detection	80% (204) <input type="text"/>
Lock	Value for switch off	0% (OFF) <input type="text"/>
Presence 2		
Presence 3		
Presence 4		
+ Inputs		
+ Temperature		
+ Logic Functions		

Fig. 15 : Constant Light-Controller - Output Page Configuration

3.4.2.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Dimming time for brightness from %0...%100	<p>This parameter is used to determine how long it takes for the output object value to go from 0% to 100% during manual dimming.</p> <p>For example, let the lighting in the environment be completely off (that is, the output is at 0%) and the value entered in this parameter is 20 seconds. In this state, when the presence detector detects a movement, the brightness of the lighting unit controlled in the environment will be 100% after 20 seconds.</p>	02:30..10:00..20:00
Dimming step size brighter	This parameter is used to specify the step size to be used for dimming upwards (dimming brighter).	1...2...15
Dimming step size darker	This parameter is used to specify the step size to be used for downward dimming (dimming darker).	1...2...15
Maximum dimming value limit	This parameter is used to determine the minimum dimming value that can be sent while the presence detector is dimming. A value higher than this value set in the parameter cannot be sent to the bus line.	100% (255) , 99% (252), 98% (250)... 3% (8), 2% (5), 1% (3), 0% (OFF)
Minimum dimming value limit	This parameter is used to determine the minimum dimming value that can be sent while the presence detector is dimming. A value lower than this value set in the parameter cannot be sent to the bus line.	100% (255), 99% (252), 98% (250)... 3% (8), 2% (5), 1% (3), 0% (OFF)
First dimming value after detection	<p>This parameter is used to set the initial value at which the presence detector will start dimming.</p> <p>For example, when a motion is detected by the presence detector in an environment where there is constant light control based on motion, the dimming process is started with this value.</p>	100% (255), 99% (252), 98% (250)... 80% (204) ...3% (8), 2% (5), 1% (3), 0% (OFF)
Value for switch off	This parameter is used to determine the value to be sent from the output object of the relevant present channel to the KNX bus line after the light-on time expires.	100% (255), 99% (252), 98% (250)... 3% (8), 2% (5), 1% (3), 0% (OFF)

3.4.3. Constant Light-Controller – Input

On this parameter subpage, the parameters for manually controlling the detector when the KNX presence detector is set up to operate in constant light control mode is described. Manual control is naturally carried out via external sources (e.g., a device on the KNX bus with pushbutton control).

For this reason, to perform manual control objects of the detector for manual control must be connected to the relevant objects of external devices.

General	Manual control	
+ Brightness Detection	Dimming time for manual from 0...%100 (0 = immediately)	<input type="text" value="3"/> s
+ Sensor (Movement)	Enable 'Manual on/off' object	<input type="radio"/> no <input checked="" type="radio"/> yes
- Presence Channels	Enable 'Relative dimming' object	<input checked="" type="radio"/> no <input type="radio"/> yes
- Presence 1	Enable 'Absolute dimming' object	<input type="radio"/> no <input checked="" type="radio"/> yes
Output	Use 'Status of control' object	<input checked="" type="radio"/> no <input type="radio"/> yes
<input type="text" value="Input"/>	Exiting manual dimming mode time (0 = no timeout)	<input type="text" value="01:00"/> hh:mm
Lock		
Presence 2		
Presence 3		
Presence 4		
+ Inputs		
+ Temperature		
+ Logic Functions		

Fig. 16 : Constant Light-Controller - Input Page Configuration

3.4.3.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Dimming time for manual from 0...%100 (0 = immediately)	<p>This parameter is used to determine how long it takes for the output object value to go from 0% to 100% during manual dimming.</p> <p>For example, let the lighting in the environment be completely off (that is, the output is at 0%) and the value entered in this parameter is 20 seconds. In this state, when an ON telegram is sent to the 'manual on/off' object from the KNX bus line, the brightness of the lighting unit controlled in the environment will be 100% after 20 seconds.</p> <p>In another case, let this parameter be configured as 20 seconds. When the output is at 50%, the time required for it to reach 100% will be 10 seconds.</p>	0...3...59
Enable 'Manual on/off' object	This parameter is used to activate or deactivate the 'manual on/off' object, which is used to manually control the presence detector while in constant light control mode. For detailed usage of this object, information checks section 4.	no yes
Enable 'Relative dimming' object	This parameter is used to activate or deactivate the 'Relative dimming' object, which is used to manually control the presence detector while in constant light control mode. For detailed usage of this object, information checks section 4.	no yes
Enable 'Absolute dimming' object	This parameter is used to activate or deactivate the 'Absolute dimming' object, which is used to manually control the presence detector while in constant light control mode. For detailed usage of this object, information checks section 4.	no yes
Use 'status of control' object	This parameter is used to activate or deactivate the status object, which is used to determine whether the KNX presence detector is operating in manual or automatic mode.	no yes
Exiting manual dimming mode time (0 = no timeout)	<p>This parameter is used to switch back to automatic mode from manual control mode. Depending on the time entered in this parameter, the detector will exit the manual mode and switch to the automatic state.</p> <p>Only when the '0' value is entered into this parameter, the detector will remain in manual mode permanently.</p>	00:00..01:00..12:00

3.4.4. Constant Light Controller – Lock

On this parameter subpage, the parameters for locking the corresponding presence channel are described. Since the locking parameters are the same as the parameters in the “sensor” channel, for a more detailed explanation the parameter properties can be viewed in the sensor channel lock section (3.3.3).

General	Use sensor lock	<input type="radio"/> no <input checked="" type="radio"/> yes
+ Brightness Detection	Telegram for lock activation	<input checked="" type="radio"/> ON telegram <input type="radio"/> OFF telegram
+ Sensor (Movement)	Output behavior when lock	<input type="radio"/> only lock <input checked="" type="radio"/> lock and transmit value
- Presence Channels	Output value	100% (255) ▾
- Presence 1	Automatic unlock after delay	<input type="radio"/> no <input checked="" type="radio"/> yes
Output	Automatic unlock time	00:00:30 hh:mm:ss
Input		
Lock		
Presence 2		
Presence 3		
Presence 4		
+ Inputs		
+ Temperature		
+ Logic Functions		

Fig. 17 : Constant Light-Controller – Lock Page Configuration

3.4.4.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Use sensor lock	Same as sensor lock	Same as sensor lock
Telegram for lock activation	Same as sensor lock	Same as sensor lock
Output behaviour when lock	Same as sensor lock	Same as sensor lock
-> Output value	Same as sensor lock	Same as sensor lock
Automatic unlock after delay	Same as sensor lock	Same as sensor lock
-> Automatic unlock time	Same as sensor lock	Same as sensor lock

3.4.5. Constant Light-Controller – Forced Operation

In this section, parameters for forcing the output of the relevant detector channel to remain at a constant value while the detector operates the constant light control are explained. Since the other presence channels are the same, only the parameters for the presence 1 channel are described. When other channels are used, this section can be referenced for the usage of relevant presence channels.

General	Stop forced operation means back to constant light control
+ Brightness Detection	Forced operation type <input checked="" type="radio"/> 1-bit object <input type="radio"/> 2-bit object
+ Sensor (Movement)	Brightness value when forced activated 0% (OFF) ▼
- Presence Channels	Forced operation value changed by bus <input checked="" type="radio"/> no <input type="radio"/> yes
- Presence 1	Forced operation value after bus return no forced operation ▼
Output	
Input	
Lock	
Forced Operation	
Presence 2	
Presence 3	
Presence 4	
+ Inputs	
+ Temperature	
+ Logic Functions	

Fig. 18 : Constant Light-Controller – Forced Operation Page Configuration

3.4.5.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Forced operation type	This parameter is used to determine the object type to trigger the detector from constant light control to forced operation state.	1-bit object 2-bit object
Brightness value when forced activated	This parameter is used to determine the brightness value of the output when the detector disables the constant light control and enters the forced operation state.	100% (255), 99% (252), 98% (250)... 3% (8), 2% (5), 1% (3), 0% (OFF)
Forced operation value changed by bus	This parameter is used to change the output brightness value over the KNX bus line when the detector goes into a forced operation state.	no yes
Forced operation value after bus return	This parameter is used to determine whether there will be forced operation after the KNX bus line voltage is restored. No forced operation : The detector will operate in the default state. Forced on : The detector will operate as a force on the state. Forced off : The detector will operate in constant light controller mode. Position before failure : The detector will operate at the last state(before bus voltage break) after bus voltage return.	no forced operation forced on forced off position before failure

3.4.6. Presence Channels Priority List

Presence channels' functions as explained in previous points. Also, all of the regarding functions have their different priority levels. "Constant Light Switch" is "Lock" prioritized first and "General Operation" prioritized second. Then, "Constant Light Controller" has "Lock" prioritized first, "Forced Operation" prioritized second, "Manuel Operation" prioritized third and "General Operation" prioritized fourth and last. Priority levels are also explained in the block diagram in Figure 19.

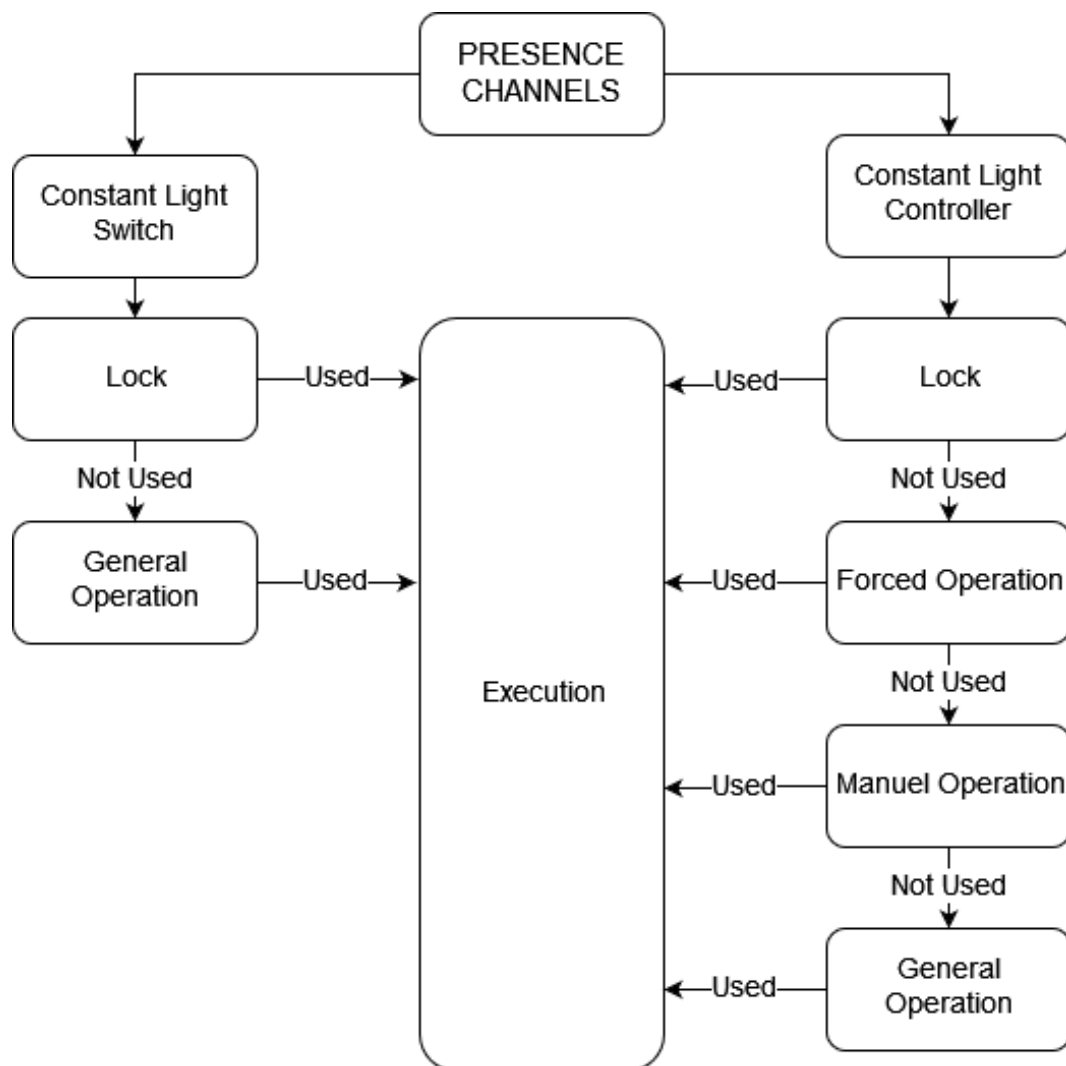


Fig. 19 : Presence Channels' Priority Levels

3.5. Inputs

Interra KNX presence sensor has 2 digital inputs and 1 analog input. By connecting buttons to digital inputs, you can choose the lighting, curtains/blinds, RGB LEDs, dim devices etc. you want to control. You can control the devices by making the necessary configurations via the KNX sensor. However, by connecting an NTC temperature sensor to the analog input, you can obtain temperature information from further distances from the KNX presence sensor.

3.5.1. Input – Switch Sensor

In this section, it is explained how to control the related automation unit via the KNX presence sensor by switching via buttons connected to digital inputs. Detailed information on the relevant parameter configurations is described in the table below.

General	Operation mode of the channel	switch sensor
+ Brightness Detection	Input name	
+ Sensor (Movement)	Distinction between long and short operation	<input checked="" type="radio"/> no <input type="radio"/> yes
+ Presence Channels	Cyclic sending of object "Switch"	no
- Inputs	Reaction on closing the contact (rising edge)	ON
Input 1	Reaction on opening the contact (falling edge)	OFF
Input 2	Scan input after bus voltage recovery	<input checked="" type="radio"/> no <input type="radio"/> yes
Additional Probe	Object is only sent, if reaction on opening / closing not equal TOGGLE	<--- NOTE
+ Temperature	Debounce time	50 ms
+ Logic Functions		

Fig. 20 : Input – Input Switch Sensor

3.5.1.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Operation Mode of the channel	This parameter is used to determine the input x operation mode. If no function is selected, the input x will not be used. For other choices, all functionalities are configured separately.	No function Switch sensor Switch/dimming sensor Shutter sensor Value/forced operation Control scene RGB colour control Mode selection
Input Name	This parameter is used to type an input name. The name can consist of up to 40 characters.	40 bytes allowed
Distinction between short and long operation	This parameter is used to set if the input differentiates between short and long operations. With the option “yes”, after opening/closing of the contact, it must, first of all, be ascertained if a short or long operation has occurred here. Only thereafter will a possible reaction be triggered.	No Yes
-> Cyclic sending of object “Switch”	This parameter is visible if there is no distinction between short and long operations. The communication object “Switch” can be sent cyclically. If the parameter “always” is set, the object sends cyclically on the bus, regardless of its value. Should the parameter value “if telegram switch = ON” or “if telegram switch = OFF” be set, the corresponding object value is sent cyclically.	No If “Switch” = OFF If “Switch” = ON always
-> Reaction on closing the contact (rising edge)	<p>This parameter is visible if there is no distinction between short and long operations. For each edge, you can set if the object value is to be switched ON, OFF or TOGGLE, or if no reaction should occur.</p> <p>If cyclical sending has been parameterized, it is possible by setting the parameter value “terminate cyclic sending” with an operation of the input, to stop cyclic sending without a new object value being sent.</p>	No reaction ON OFF TOGGLE

<p>-> Reaction on opening the contact (Falling edge)</p>	<p>This parameter is visible if there is no distinction between short and long operations. For each edge, you can set if the object value is to be switched ON, OFF or TOGGLE, or if no reaction should occur.</p> <p>If cyclical sending has been parameterized, it is possible by setting the parameter value “terminate cyclic sending” with an operation of the input, to stop cyclic sending without a new object value being sent.</p>	<p>No reaction ON OFF TOGGLE</p>
<p>-> Telegram is repeated every</p>	<p>This parameter is visible if the cyclical transmission is active. The send cycle time describes the time used between two cyclically transmitted telegrams</p>	<p>00:00:05...00:00:30 ...18:12:15</p>
<p>Scan input after bus voltage recovery</p>	<p>This parameter is used to determine the scanning of the inputs when the bus voltage has been recovered.</p>	<p>No Yes</p>
<p>Object is only sent, if reaction on opening / closing not equal TOGGLE</p>	<p>NOTE</p>	<p>NOTE</p>
<p>Connected contact type</p>	<p>This parameter is used to specify the contact type that is connected to the KNX Sensor input x.</p>	<p>Normally closed Normally open</p>
<p>Reaction on short operation</p>	<p>This parameter is visible if there is a distinction between short and long operations. It is used to determine the short press operation sending the value of the input x.</p>	<p>No reaction ON OFF TOGGLE</p>
<p>Reaction on long operation</p>	<p>This parameter is visible if there is a distinction between short and long operations. It is used to determine the long-press operation sending the value of the input x.</p>	<p>No reaction ON OFF TOGGLE</p>
<p>Long operation after</p>	<p>This parameter is used to determine long operation detection after the button press operation. For making a long operation, the button should be pressed at least the configured value.</p>	<p>00:00:200...00:00:5 00...01:05:000</p>
<p>Number of object for short/long operation</p>	<p>This parameter is used to determine the object count to use for short and long operations.</p>	<p>1 object 2 object</p>

	<p>1 object: short and long operations will proceed with the same object.</p> <p>2 object: Short and long operations will proceed with 2 different objects.</p>	
Debounce time	This parameter is used to determine the debounce time. Debouncing prevents unwanted multiple operations of the input, e.g., due to bouncing of the contact.	10 ms 20 ms 30 ms 40 ms 50 ms 70 ms 100 ms 150 ms

3.5.2. Input – Switch / Dimming Sensor

In this section, it is explained how to control the unit of a lighting unit through the KNX presence sensor, both by switching and dimming, via the buttons connected to the digital inputs. Detailed information on the relevant parameter configurations is described in the table below. Make sure that the lighting unit to be controlled has a dimming feature.

General	Operation mode of the channel	switch / dimming sensor
+ Brightness Detection	Input name	
+ Sensor (Movement)	Connected contact type	<input type="radio"/> normally closed <input checked="" type="radio"/> normally open
+ Presence Channels	Dimming functionality	<input checked="" type="radio"/> only dimming <input type="radio"/> dimming and switching
- Inputs	Reaction on operation	dimming brighter/darker
Input 1	Dimming mode	<input checked="" type="radio"/> start stop dimming <input type="radio"/> dimming step
Input 2	Debounce time	50 ms
Additional Probe		
+ Temperature		
+ Logic Functions		

Fig. 21 : Input – Input Switch / Dimming Sensor

3.5.2.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Operation Mode of the channel	This parameter is used to determine the input x operation mode. If no function is selected, the input x will not be used. For other choices, all functionalities are configured separately.	No function Switch sensor Switch/dimming sensor Shutter sensor Value/forced operation Control scene RGB colour control Mode selection
Input Name	This parameter is used to type an input name. The name can be consisting of 40 characters.	40 bytes allowed
Connected contact type	This parameter is used to specify the contact type that is connected to the KNX Sensor input x.	Normally closed Normally open
Dimming functionality	This parameter is used to define if the lighting can only be dimmed “Only dimming” or if additional switching is also permitted “Dimming and switching”. In this case, a long button press dims and a short button push switch.	Only dimming Dimming and switching
Reaction on operation	This parameter is visible if “Only dimming” dimming functionality is set. A distinction is not made between short and long operations here.	Dimming brighter Dimming darker Dimming brighter/darker
Reaction on short operation	This parameter is visible if there is a distinction between short and long operations. It is used to determine the short press operation sending the value of the input x.	No reaction ON OFF TOGGLE
Reaction on long operation	This parameter is visible if there is a distinction between short and long operations. It is used to determine the long-press operation sending the value of the input x.	Dimming brighter Dimming darker Dimming brighter/darker

Long operation after	This parameter is used to determine long operation detection after the button press operation. For making a long operation, the button should be pressed at least the configured value.	00:00.200... 00:00.500 ...01:05.000
Dimming mode	This parameter is used to determine the dimming mode. Normal “Start-stop-dimming” starts the dimming process with a telegram BRIGHTER or DARKER and ends the dimming process with a STOP telegram. Cyclic sending of the telegram is not necessary in this case. With “Dimming steps”, the dimming telegram is sent cyclically during a long operation. The STOP telegram ends the dimming process at the end of the operation.	Start-stop dimming Dimming step
Brightness change on every sent telegram	This parameter is only visible with “Dimming steps”. This parameter is set to change the brightness (in per cent), which is cyclically sent with every dimming telegram.	%100 %50 %25 %12.5 %6.25 %3.13 %1.56
Sending cycle time : Telegram is repeated every	This parameter is used to determine the sending cycle time. The dimming telegram is sent cyclically during a long operation if “Dimming steps” is set. The cycle time for sending corresponds with the time interval between two telegrams during cyclical sending.	0.3s, 0.4s, 0.5s , 0.6s, 0.8s, 1s, 1.2s, 1.5s, 2s, 3s, 4s, 5s, 6s, 7s, 8s, 9s, 10s,
Debounce time	This parameter is used to determine the debounce time. Debouncing prevents unwanted multiple operations of the input, e.g., due to bouncing of the contact.	10 ms 20 ms 30 ms 40 ms 50 ms 70 ms 100 ms 150 ms

3.5.3. Input – Shutter Sensor

In this section, it is explained how to control a shutter/blind unit via the buttons connected to the digital inputs via the KNX presence sensor. Detailed information on the relevant parameter configurations is described in the table below.

General	Operation mode of the channel	shutter sensor
+ Brightness Detection	Input name	
+ Sensor (Movement)	Operating functionality of blind	1-push button, short = stepping, long = moving
+ Presence Channels	Short operation: Lamella Long operation: Move UP / DOWN	<--- NOTE
- Inputs	Connected contact type	<input type="radio"/> normally closed <input checked="" type="radio"/> normally open
Input 1	Long operation after	0.5s
Input 2	Debounce time	50 ms
Additional Probe		
+ Temperature		
+ Logic Functions		

Fig. 22 : Input – Input Shutter Sensor

3.5.3.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Operation Mode of the channel	This parameter is used to determine the input x operation mode. If no function is selected, the input x will not be used. For other choices, all functionalities are configured separately.	No function Switch sensor Switch/dimming sensor Shutter sensor Value/forced operation Control scene RGB colour control Mode selection
Input Name	This parameter is used to type an input name. The name can be consisting of 40 characters.	40 bytes allowed
Operation Functionality of blind	This parameter is used to define the type of blind operation. An overview of the operating modes is described below.	1-push-button, short = stepping, long = moving 1-push-button, short = moving, long = stepping 1-push-button-operation 1-switch button operation 2-push-button, standard 2-switch-operation, moving 2-push-button, moving 2-push-button, stepping
Connected contact type	This parameter is used to specify the contact type that is connected to the KNX Sensor input x.	Normally closed Normally open
1-push-button, short = stepping, long = moving		
Short Operation : Lamella	NOTE	NOTE

Long Operation : Move UP / DOWN		
Long operation after	This parameter is used to determine long operation detection after the button press operation. For making a long operation, the button should be pressed at least the configured value.	0.3s, 0.4s, 0.5s , 0.6s, 0.8s, 1s, 1.2s, 1.5s, 2s, 3s, 4s, 5s, 6s, 7s, 8s, 9s, 10s,
1-push-button, short = moving, long = stepping		
Short Operation : Move UP / DOWN Long Operation : Lamella	NOTE	NOTE
Long operation after	This parameter is used to determine long operation detection after the button press operation. For making a long operation, the button should be pressed at least the configured value.	0.3s, 0.4s, 0.5s , 0.6s, 0.8s, 1s, 1.2s, 1.5s, 2s, 3s, 4s, 5s, 6s, 7s, 8s, 9s, 10s,
“STOP/Lamella adj.” is repeated every	This parameter is used to determine the time between two telegrams is set. This parameter is visible in operations in which the object “STOP/lamella adjustment” is sent cyclically on the bus during a long operation.	0.3s, 0.4s , 0.5s, 0.6s, 0.8s, 1s, 1.2s, 1.5s, 2s, 3s, 4s, 5s, 6s, 7s, 8s, 9s, 10s,
1-push button operation		
On Every operation in success: UP – STOP – DOWN - STOP	NOTE	NOTE
1-switch button operation		
On operation : UP – DOWN End of operation : STOP	NOTE	NOTE
2-push button, standard		
Short Operation : STOP – Lamella UP / DOWN Long Operation : Move UP / DOWN	NOTE	NOTE
Reaction on short operation	This parameter is visible if there is a distinction between short and long operations. It is used to determine the short press operation sending the value of the input x.	Stop / lamella up Stop / lamella down

Reaction on long operation	This parameter is visible if there is a distinction between short and long operations. It is used to determine the long-press operation sending the value of the input x.	Move up Move down
Long operation after	This parameter is used to determine long operation detection after the button press operation. For making a long operation, the button should be pressed at least the configured value.	0.3s, 0.4s, 0.5s , 0.6s, 0.8s, 1s, 1.2s, 1.5s, 2s, 3s, 4s, 5s, 6s, 7s, 8s, 9s, 10s,
2-switch operation, moving		
On Operation : Moving End of Operation : STOP	NOTE	NOTE
Reaction on operation	This parameter is used to determine the reaction when an operation occurs. A distinction is not made between short and long operations here.	Move up Move down
2-push button operation, moving		
On Operation : Moving End of Operation : STOP	NOTE	NOTE
Reaction on operation	This parameter is used to determine the reaction when an operation occurs. A distinction is not made between short and long operations here.	Move up Move down
2-push-button, stepping		
On Operation : Stepping	NOTE	NOTE
Reaction on operation	This parameter is used to determine the reaction when an operation occurs. A distinction is not made between short and long operations here.	Stop / Lamella up Stop / Lamella down
“STOP/Lamella adj.” is repeated every	This parameter is used to determine the time between two telegrams is set. This parameter is visible in operations in which the object “STOP/lamella adjustment” is sent cyclically on the bus during a long operation.	0.3s, 0.4s , 0.5s, 0.6s, 0.8s, 1s, 1.2s, 1.5s, 2s, 3s, 4s, 5s, 6s, 7s, 8s, 9s, 10s,
Debounce time	This parameter is used to determine the debounce time. Debouncing prevents unwanted multiple operations of the input, e.g. due to bouncing of the contact.	10 ms 20 ms 30 ms 40 ms

		50 ms 70 ms 100 ms 150 ms
--	--	---

3.5.3.2. The Functionality of Each Function

1 push button: Short Press = stepping, Long Press = moving	
Short Operation	Stop/ Lamella Adjustment
Long Operation	Toggle between “Move Up” and “Move Down”
1 push button: Short Press = moving, Long Press = stepping	
Short Operation	Toggle between “Move Up” and “Move Down”
Long Operation	Stop/Lamella Adjustment (Sent Cyclically as the button is kept pressed)
1 push button: Press: moving, Long Press Disabled	
On Operation	Following signals are sent in order on each press. → Move UP → Stop/Lamella Adj. Up → Move Down → Stop/Lamella Adj. Down →
1 switch Operation: Moving, Long Press Disabled	
Press Operation	Toggle between “Move Up” and “Move Down”
Release Operation	Stop/Lamella Adjustment
2 Push Button Operation: Standard	
Short Operation	“Stop/Lamella Adj. Down” or Stop/Lamella Adj. Up (Whichever is chosen as the parameter)
Long Operation	“Move Up” or “Move Down” (Whichever is chosen as the parameter)
2 Switch Operation: Moving, Long Press Disabled	
Press Operation	“Move Up” or “Move Down” (Whichever is chosen as the parameter)
Release Operation	“Stop/Lamella Adj. Down” or “Stop/Lamella Adj. Up” (Whichever is chosen)
2 Push Button Operation: Moving, Long Press Disabled	
On Operation	Whichever sequence is selected as the parameter; “ → Move Up → Stop/Lamella Adj. Up → “ or “ → Move Down → Stop/Lamella Adj. Down → “
2 Push Button Operation: Stepping, Long Press Disabled	

On Operation	Whichever signal is selected as the parameter, is sent cyclically as the button is kept pressed; “Stop/Lamella Adj. Up” or “Stop/Lamella Adj. Down”
--------------	--

3.5.4. Input Value / Forced Operation

In this section, it is explained how to control an automation unit via KNX presence sensor via a value/forced via buttons connected to digital inputs. Detailed information on the relevant parameter configurations is described in the table below.

General	Operation mode of the channel	value / forced operation
+ Brightness Detection	Input name	
+ Sensor (Movement)	Connected contact type	<input type="radio"/> normally closed <input checked="" type="radio"/> normally open
+ Presence Channels	Distinction between long and short operation	<input checked="" type="radio"/> no <input type="radio"/> yes
- Inputs	Reaction on operation	1Byte DPT 5.001 Percent (0...100%)
Input 1	sent value	0% (OFF)
Input 2	Scan input after bus voltage recovery	<input checked="" type="radio"/> no <input type="radio"/> yes
Additional Probe	Debounce time	50 ms
+ Temperature		
+ Logic Functions		

Fig. 23 : Input – Input Value / Forced Operation

3.5.4.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Operation Mode of the channel	This parameter is used to determine the input x operation mode. If no function is selected, the input x will not be used. For other choices, all functionalities are configured separately.	No function Switch sensor Switch/dimming sensor Shutter sensor Value/forced operation Control scene RGB colour control Mode selection
Input Name	This parameter is used to type an input name. The name can be consisting of 40 characters.	40 bytes allowed
Connected contact type	This parameter is used to specify the contact type that is connected to the KNX Sensor input x.	Normally closed Normally open
Distinction between short and long operation	This parameter is used to set if the input differentiates between short and long operations. With the option “yes”, after opening/closing of the contact, it must, first of all, be ascertained if a short or long operation has occurred here. Only thereafter will a possible reaction be triggered.	No Yes
Reaction on short operation	This parameter is visible if there is a distinction between short and long operations. It is used to determine the short press operation sending the value of the input x.	2-bit DPT 2.001 Switch Control 1-byte DPT 5.001 Percent (0...100%) 1-byte DPT 5.005 Decimal factor (0...255) 1-byte DPT 17.001 Scene Number 2-byte DPT 7.600 Color temperature(Kelvin) 2-byte DPT 9.001 Color temperature (°C) 2-byte DPT 9.004 Brightness (Lux)

		3-byte DPT 232.600 RGB value 3x (0...255)
-> sent value	This parameter is used to determine the sending value to the bus when a short operation occurs.	Values depends on DPT selection.
Reaction on long operation	This parameter is visible if there is a distinction between short and long operations. It is used to determine the long-press operation sending the value of the input x.	2-bit DPT 2.001 Switch Control 1-byte DPT 5.001 Percent (0...100%) 1-byte DPT 5.005 Decimal factor (0...255) 1-byte DPT 17.001 Scene Number 2-byte DPT 7.600 Color temperature(Kelvin) 2-byte DPT 9.001 Color temperature (°C) 2-byte DPT 9.004 Brightness (Lux) 3-byte DPT 232.600 RGB value 3x (0...255)
-> sent value	This parameter is used to determine the sending value to the bus when a long operation occurs.	Values depends on DPT selection.
Long operation after	This parameter is used to determine long operation detection after the button press operation. For making a long operation, the button should be pressed at least the configured value.	00:00.200... 00:00.4 00...01:05.000
Debounce time	This parameter is used to determine the debounce time. Debouncing prevents unwanted multiple operations of the input, e.g., due to bouncing of the contact.	10 ms 20 ms 30 ms 40 ms 50 ms 70 ms 100 ms 150 ms

3.5.5. Input – Control Scene

In this section, it is explained how to control the related automation unit via the KNX presence sensor by triggering a scenario via buttons connected to digital inputs. Detailed information on the relevant parameter configurations is described in the table below.

General	Operation mode of the channel	control scene
+ Brightness Detection	Input name	
+ Sensor (Movement)	Connected contact type	<input type="radio"/> normally closed <input checked="" type="radio"/> normally open
+ Presence Channels	Scene number	scene no: 1
- Inputs	Recall scene	<input type="radio"/> no <input checked="" type="radio"/> on short operation
Input 1	Store scene	no reaction
Input 2	Debounce time	50 ms
Additional Probe		
+ Temperature		
+ Logic Functions		

Fig. 24 : Input – Control Scene

3.5.5.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Operation Mode of the channel	This parameter is used to determine the input x operation mode. If no function is selected, the input x will not be used. For other choices, all functionalities are configured separately.	No function Switch sensor Switch/dimming sensor Shutter sensor Value/forced operation Control scene RGB colour control Mode selection
Input Name	This parameter is used to type an input name. The name can be consisting of 40 characters.	40 bytes allowed
Connected contact type	This parameter is used to specify the contact type that is connected to the KNX Sensor input x.	Normally closed Normally open
Scene Number	This parameter is used to configure the scene number to send to the KNX when a short press operation occurs.	Scene no.1 ...Scene no.64
Recall scene	This parameter is used to determine the recalling of the scene. If this parameter is selected as “on short operation” the configured scene number will be called.	No On short operation
Store Scene	This parameter is used to determine to store or not to store the related scene. On long operation : The scene will be stored after a long operation. With “Store scene” obj. value = 1 : The scene will be stored on operation if the Store scene object value is 1. On long operation (“Store scene” obj. value = 1) : The scene will be stored on long operation if the Store scene object is 1.	No reaction On long operation With “Store scene” obj value = 1 On long operation (“Store scene” obj value = 1)
Long operation after	This parameter is used to determine long operation detection after the button press operation. For making a long operation, the button should be pressed at least the configured value.	00:00.200... 00:00.5 00 ...01:05.000

Debounce time	This parameter is used to determine the debounce time. Debouncing prevents unwanted multiple operations of the input, e.g., due to bouncing of the contact.	10 ms 20 ms 30 ms 40 ms 50 ms 70 ms 100 ms 150 ms
----------------------	---	---

3.5.6. Input – RGB Colour Control

In this section, it is explained how to control an RGB LED device through the buttons connected to the digital inputs via the KNX presence sensor. Detailed information on the relevant parameter configurations is described in the table below.

General	Operation mode of the channel	RGB colour control
+ Brightness Detection	Input name	
+ Sensor (Movement)	Connected contact type	<input type="radio"/> normally closed <input checked="" type="radio"/> normally open
+ Presence Channels	Set colour value	red
- Inputs	Change colour with long operation	<input checked="" type="radio"/> no <input type="radio"/> yes
Input 1	RGB object type	<input checked="" type="radio"/> three object of one byte <input type="radio"/> one object of three bytes
Input 2	Debounce time	50 ms
Additional Probe		
+ Temperature		
+ Logic Functions		

Fig. 25 : Input – RGB Colour Control

3.5.6.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Operation Mode of the channel	This parameter is used to determine the input x operation mode. If no function is selected, the input x will not be used. For other choices, all functionalities are configured separately.	No function Switch sensor Switch/dimming sensor Shutter sensor Value/forced operation Control scene RGB colour control Mode selection
Input Name	This parameter is used to type an input name. The name can be consisting of 40 characters.	40 bytes allowed
Connected contact type	This parameter is used to specify the contact type that is connected to the KNX Sensor input x.	Normally closed Normally open
Set colour value	This parameter is used to set RGB colours according to the configured values.	Red Orange Yellow Green-yellow Green Green-cyan Cyan Blue-cyan Blue Blue-magenta Red-magenta white
Change colour with long operation	This parameter is used to enable or disable the colour changing with long press operation.	No Yes
Long operation after	This parameter is used to determine long operation detection after the button press operation. For making a long operation, the button should be pressed at least the configured value.	00:00.200... 00:00.5 00...01:05.000
RGB object type	This parameter is used to determine the RGB colour object type.	Three object of one byte

		one object of three bytes
Debounce time	This parameter is used to determine the debounce time. Debouncing prevents unwanted multiple operations of the input, e.g., due to bouncing of the contact.	10 ms 20 ms 30 ms 40 ms 50 ms 70 ms 100 ms 150 ms

3.5.7. Input – Mode Selection

In this section, it is explained how to control the operating modes of an HVAC unit via the buttons connected to the digital inputs via the KNX presence sensor. Detailed information on the relevant parameter configurations is described in the table below.

General	Operation mode of the channel	mode selection
+ Brightness Detection	Input name	
+ Sensor (Movement)	Connected contact type	<input type="radio"/> normally closed <input checked="" type="radio"/> normally open
+ Presence Channels	Distinction between long and short operation	<input checked="" type="radio"/> no <input type="radio"/> yes
- Inputs	Switching on operation	comfort / standby
Input 1	Switchover considers "State HVAC-Mode" object	<input checked="" type="radio"/> no <input type="radio"/> yes
Input 2	Debounce time	50 ms
Additional Probe		
+ Temperature		
+ Logic Functions		

Fig. 26 : Input – Mode Selection

3.5.7.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Operation Mode of the channel	This parameter is used to determine the input x operation mode. If no function is selected, the input x will not be used. For other choices, all functionalities are configured separately.	No function Switch sensor Switch/dimming sensor Shutter sensor Value/forced operation Control scene RGB colour control Mode selection
Input Name	This parameter is used to type an input name. The name can be consisting of 40 characters.	40 bytes allowed
Distinction between short and long operation	This parameter is used to set if the input differentiates between short and long operations. With the option “yes”, after opening/closing of the contact, it must, first of all, be ascertained if a short or long operation has occurred here. Only thereafter will a possible reaction be triggered.	No Yes
->Switching on short operation	This parameter is visible if there is a distinction between short and long operations. It is used to determine the short press operation sending the value of the input x.	Comfort / standby Comfort / economy Comfort / standby / economy Comfort / standby / economy / frost
-> Reaction on long operation	This parameter is visible if there is a distinction between short and long operations. It is used to determine the long-press operation sending the value of the input x.	Comfort / standby Comfort / economy Comfort / standby / economy Comfort / standby / economy / frost
Long operation after	This parameter is used to determine long operation detection after the button press operation. For making a long operation, the button should be pressed at least the configured value.	00:00.200... 00:00.5 00 ...01:05.000

Switchover considers “State HVAC-Mode” object	This parameter is used to enable the HVAC-Mode state object to change the current HVAC mode via KNX.	No Yes
Debounce time	This parameter is used to determine the debounce time. Debouncing prevents unwanted multiple operations of the input, e.g., due to bouncing of the contact.	10 ms 20 ms 30 ms 40 ms 50 ms 70 ms 100 ms 150 ms

3.5.8. Input – Additional Probe

This section describes how to configure a parameter for an NTC sensor that can be connected to the analog input of the KNX presence sensor. After obtaining the necessary information about the NTC sensor to be connected from the relevant document, you should configure it.

General	Enable "Lock" object	<input type="radio"/> no <input checked="" type="radio"/> yes
+ Brightness Detection	Lock initial state	<input type="radio"/> disable <input checked="" type="radio"/> enable
+ Sensor (Movement)	Lock activation telegram	<input type="radio"/> telegram 0 <input checked="" type="radio"/> telegram 1
+ Presence Channels	Enable "Temperature" object	<input type="radio"/> no <input checked="" type="radio"/> yes
- Inputs	Sending on variation	never ▼
Input 1	Cyclic sending of value (0 = disable)	00:00 hh:mm
Input 2	Sensor calibration	0 0.1°C
Additional Probe	Number of sample	10
+ Temperature	NTC resistance	10000
+ Logic Functions	NTC B value	3850

Fig. 27 : Input – Additional Probe

3.5.8.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Enable “Lock” Object	This parameter is used to enable or disable the lock object.	No Yes
-> Initial enable state	This parameter is used to determine the initial state of the lock status. If it is selected as enable, the initial status of the lock will be enabled.	Disable Enable
-> Enable Activation Telegram	This parameter is used to determine the telegram value to activate the lock. E.g., if it is selected as telegram 1, a “1” value telegram will lock and a “0” value telegram will unlock. Vice versa also applies.	Telegram 0 Telegram 1
Enable “Temperature” Object	This parameter is used to enable or disable the Temperature object to send the measured temperature values of the ambient to the bus.	No Yes
-> Sending On Variation	This parameter is used to determine the temperature variation value. If it is selected as never, the current value will be sent.	Never 0.1 °C 0.2 °C 0.3 °C 0.4 °C 0.5 °C 0.6 °C 0.7 °C 0.8 °C 0.9 °C 1.0 °C 1.1 °C 1.2 °C 1.3 °C 1.4 °C 1.5 °C
-> Cyclic sending of value (0 = disable)	This parameter is used to determine the cyclic sending period value of the measured temperature value.	00:00...23.59

Sensor Calibration	<p>This parameter is used to determine the calibration value of the analogue probe.</p> <p>E.g., the Measured value is 25 °C, and the calibration value is selected as 10.</p> <p>The calibrated value is $25 - (10 \times 0.1) = 24$ °C.</p> <p>0.1 is a constant factor value.</p>	-100... 0 ...100
Number of Sample	<p>This parameter is used to determine the number of samples of the temperature values to calculate the ambient temperature.</p>	0... 10 ...255
NTC resistance	<p>This parameter is used to determine the NTC resistance value that will be connected to the analogue input of the KNX sensor.</p>	0... 10000 ...65535
NTC B value	<p>This parameter is used to determine the NTC B value that will be connected to the analogue input of the KNX sensor.</p>	0... 3850 ...65535

3.6. Temperature

Temperature is a quantity that should always be measured for a comfortable life in building automation systems. Temperature measurements can be made from a variety of sources. Interra KNX valence sensor temperature measurement can be made with the internal temperature sensor, an external NTC sensor that can be connected to its analog input, or the values obtained over the KNX bus line.

3.6.1. Temperature Info

This section provides information on configuring temperature parameters and what they mean. Detailed information about the parameters is given in the table below.

The screenshot shows the configuration page for a 'Presence Detector Mini Plus' under the 'Temperature' section. The page title is '--- Presence Detector Mini Plus > Temperature > Temperature'. On the left, there is a sidebar menu with options: General, Brightness Detection, Sensor (Movement), Presence Channels, Inputs, Temperature (selected), and Logic Functions. The main content area displays the following settings:

Temperature source	mix of external and KNX probe
Enable "Alarm" object	<input type="radio"/> no <input checked="" type="radio"/> yes
Enable "Actual temperature" object	<input type="radio"/> no <input checked="" type="radio"/> yes
Cyclic sending of temperature value (0 = disable)	00:00 hh:mm
Sending on variation	never
Weight of external probe	50%
External sensor calibration	0 0.1°C
KNX sensor calibration	0 0.1°C
Surveillance time for KNX probe (0 = disable)	15 min

Fig. 28 : Temperature – Temperature Info

3.6.1.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Temperature source	<p>This parameter is used to determine the temperature source for measuring the ambient temperature.</p> <p>Several options can be made : you can choose a single source or also a mix of 2 different sources according to needs.</p>	<p>Internal probe</p> <p>External probe</p> <p>Mix of internal and external probe</p> <p>KNX probe</p> <p>Mix of internal and KNX probe</p> <p>Mix of external and KNX probe</p>
Enable “Alarm” Object	<p>This parameter is used to enable the “Alarm” object to define a threshold value for alarm information.</p>	<p>No</p> <p>Yes</p>
Enable “Actual Temperature” Object	<p>This parameter is used to enable the “Actual Temperature” object to send the actual ambient temperature value to the bus.</p>	<p>No</p> <p>Yes</p>
-> Cyclic sending of temperature value (0 = disable)	<p>This parameter is used to determine the cyclic sending period time of the current temperature value. If it is selected as 00:00, the cyclic sending will be disabled.</p>	<p>00:00...23.59</p>
-> Sending on variation	<p>This parameter is used to determine the temperature variation value. If it is selected as never, the current value will be sent.</p>	<p>Never</p> <p>0.1 °C</p> <p>0.2 °C</p> <p>0.3 °C</p> <p>0.4 °C</p> <p>0.5 °C</p> <p>0.6 °C</p> <p>0.7 °C</p> <p>0.8 °C</p> <p>0.9 °C</p> <p>1.0 °C</p> <p>1.1 °C</p> <p>1.2 °C</p> <p>1.3 °C</p>

		1.4 °C 1.5 °C
Weight Of External Probe	<p>This parameter is used to determine the weight of the external probe.</p> <p>E.g., the temperature source is selected as Mix of the internal and external probe.</p> <p>The external probe weight is selected as %50.</p> <p>So, the calculated temperature value will be : Calculated Temperature : Internal Temperature * 0.5 + External Temperature * 0.5.</p>	%10, %20, %30, %40, %50 , %60, %70, %80, %90
Internal Sensor Calibration	<p>This parameter is used to determine the calibration value of the internal sensor.</p> <p>E.g., the Measured value is 23 °C, and the calibration value is selected as -10.</p> <p>The calibrated value is $23 - (10 \times 0.1) = 22$ °C.</p> <p>0.1 is a constant factor value.</p>	-100... 0 ...100
External Sensor Calibration	<p>This parameter is used to determine the calibration value of the external sensor.</p> <p>E.g., the Measured value is 26 °C, and the calibration value is selected as -20.</p> <p>The calibrated value is $26 - (20 \times 0.1) = 24$ °C.</p>	-100... 0 ...100
KNX Sensor Calibration	<p>This parameter is used to determine the calibration value is received from the KNX Probe temperature object.</p> <p>E.g., the Measured value is 20 °C, and the calibration value is selected as 20.</p> <p>The calibrated value is $20 + (20 \times 0.1) = 22$ °C.</p>	-100... 0 ...100
Surveillance time for KNX probe (0 = disable)	<p>This parameter is used to determine the surveillance time for the KNX probe.</p> <p>E.g., if this parameter is configured as 10. Every 10 min the received value from KNX is taken into account for temperature calculation.</p>	0... 15 ...255

3.7. Virtual Card Holder

In this section, the 'virtual card holder' feature, which is intended to be provided by the KNX presence sensor and which is the equivalent of the card holder systems used in hotels, is explained. In addition, scenarios such as 'welcome scenario' customers when the relevant hotel room is taken and 'good bye scenario' scenarios, when they leave the room, can also be realized with the 'virtual card holder' feature. With this feature, you can remove the Holder for access control. This logical module provides a set of parameters and communication objects that, suitably configured, allow you to set up whether or not a person is occupying the room.

3.7.1. Virtual Card Holder – General

In this section, the general parameters of the 'virtual card holder' feature, which is the equivalent of the card holder systems used especially in hotels, are explained.

General	Presence wait time	00:15	hh:mm
+ Brightness Detection	Presence send cyclicly	<input checked="" type="radio"/> no <input type="radio"/> yes	
+ Sensor (Movement)	Enable unexpected presence	<input checked="" type="radio"/> no <input type="radio"/> yes	
+ Presence Channels	Booked state after download	<input checked="" type="radio"/> non-booked <input type="radio"/> booked	
+ Inputs	Door is left open longer then wait time	<input type="radio"/> do nothing <input checked="" type="radio"/> forced presence	
+ Temperature	Additional output type	value 0 - 255	
- Virtual Card Holder			
General			
Output			
Internal Inputs			
Remote Inputs			
+ Logic Functions			

Fig. 29 : Virtual Card Holder – General

3.7.1.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Presence wait time	This parameter is used to set the “wait time” for the virtual holder module. The “wait time” is the time triggered by the opening and consequent closing of the door. During this time the room is in “wait mode and after this can go in “occupied” or “non occupied” status.	00:05...00:15...06:00
Presence send cyclically	This parameter is used to determine the sending the presence status or not.	No Yes
-> Cyclical Send time	This parameter is used to determine the cyclical sending time of the virtual holder presence output.	1...5...60
Enable unexpected presence	This parameter enables the sensor to sense the unexpected presence	no yes
->Send welcome on unexpected presence	This parameter is used to define the behaviour when the virtual holder module detects a presence inside the room and is in “not occupied” status 'unexpected presence'. It's possible to send or not the welcome event	Contact closed with door closed Contact closed with door open
->Enable Unexpected Presence Object	This parameter creates the “unexpected presence” object, which gives the value “1” when the sensor senses the unexpected presence	No Yes
Booked state after download	This parameter is used to set the initial value for the object virtual holder room booked	Non-booked Booked
Door is left open longer than wait time	When the parameter is set to the forced presence and if the door is kept open longer than the “Presence waits time”, the virtual cardholder will automatically act as if it has detected presence.	Do Nothing Forced Presence
Additional output type	This parameter is used to enable an additional object to transmit on the bus a command linked to presence or absence events	Value 0 – 255 Value 0 – 100% scene

3.7.2. Virtual Card Holder – Output

In this section, the output parameters of the 'virtual card holder' feature, which is the equivalent of the cardholder systems used especially in hotels, are explained.

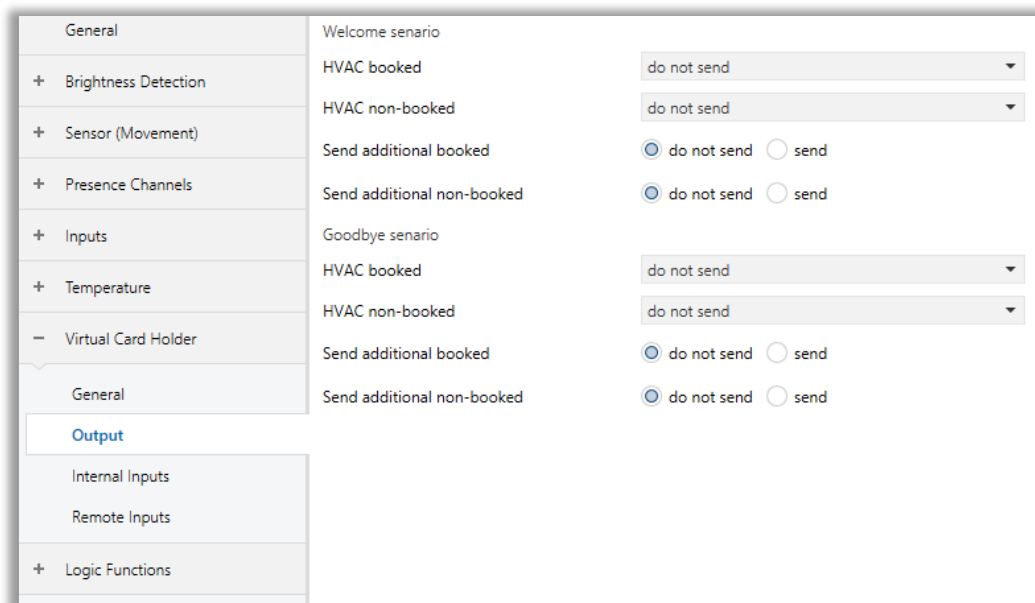


Fig. 30 : Virtual Card Holder – Output

3.7.2.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Welcome scenario		
HVAC booked	This parameter is used to determine the HVAC status of the welcome scenario when the room is booked.	Do not send Comfort Standby Economy Building Protection
HVAC Non-booked	This parameter is used to determine the HVAC status of the welcome scenario when the room is non-booked.	Do not send Comfort Standby Economy Building Protection
Send additional booked	This parameter is used to determine sending or not sending a value within the welcome scenario to the bus while the room is additionally booked.	Do not send send
-> Value additional booked	This parameter is used to determine the sending value within the welcome scenario if the room is additionally booked.	%0...%100
Send additional non-booked	This parameter is used to determine sending or not sending a value within the welcome scenario to the bus while the room is additional non-booked.	Do not send send
-> Value additional non-booked	This parameter is used to determine the sending value within the welcome scenario if the room is additional non-booked.	%0...%100
Goodbye scenario		
HVAC booked	This parameter is used to determine the HVAC status of the goodbye scenario when the room is booked.	Do not send Comfort Standby Economy Building Protection
HVAC Non-booked	This parameter is used to determine the HVAC status of the goodbye scenario when the room is non-booked.	Do not send Comfort Standby Economy

		Building Protection
Send additional booked	This parameter is used to determine sending or not sending a value within the goodbye scenario to the bus while the room is additionally booked.	Do not send send
-> Value additional booked	This parameter is used to determine the sending value within the goodbye scenario if the room is additionally booked.	%0...%100
Send additional non-booked	This parameter is used to determine sending or not sending a value within the goodbye scenario to the bus while the room is additional non-booked.	Do not send send
-> Value additional non-booked	This parameter is used to determine the sending value within the goodbye scenario if the room is additional non-booked.	%0...%100

3.7.3. Virtual Card Holder – Internal Inputs

In this section, the internal input parameters used to realize the 'virtual card holder' feature, which is the equivalent of the cardholder systems used in hotels, are mentioned. Internal inputs are the inputs on the KNX presence sensor.

Note: At least one of the input types of total inputs must be selected as the door for sake of the functionality.

General	Internal input 1 type	door
+ Brightness Detection	Contact type	<input checked="" type="radio"/> contact closed with door closed <input type="radio"/> contact closed with door open
+ Sensor (Movement)	Internal input 2 type	disabled
+ Presence Channels		
+ Inputs		
+ Temperature		
- Virtual Card Holder		
General		
Output		
Internal Inputs		
Remote Inputs		
+ Logic Functions		

Fig. 31 : Virtual Card Holder – Internal Inputs

3.7.3.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Internal input type 1	<p>This parameter is used to connect the internal inputs of the KNX presence sensor to the door or conventional presence sensor.</p> <p>Door : Internal input is connected to a door contact</p> <p>Presence Sensor : Internal input is connected to a conventional presence detector.</p>	<p>Disabled</p> <p>Door</p> <p>Presence Sensor</p>
-> Contact type	<p>This parameter is used to determine the contact type that will the door contact is closed with door open or close.</p>	<p>Contact closed with door closed</p> <p>Contact closed with door open</p>
-> Contact type	<p>This parameter is used to determine the connected contact type as normally closed or normally open.</p>	<p>Normally closed</p> <p>Normally open</p>
Internal input type 2	<p>This parameter is used to connect the internal inputs of the KNX presence sensor to the door or conventional presence sensor.</p> <p>Door: Internal input is connected to a door contact</p> <p>Presence Sensor: Internal input is connected to a conventional presence detector.</p>	<p>Disabled</p> <p>Door</p> <p>Presence Sensor</p>
-> Contact type	<p>This parameter is used to determine the contact type that will the door contact is closed with door open or close.</p>	<p>Contact closed with door closed</p> <p>Contact closed with door open</p>
-> Contact type	<p>This parameter is used to determine the connected contact type as normally closed or normally open.</p>	<p>Normally closed</p> <p>Normally open</p>

3.7.4. Virtual Card Holder – Remote Input

In this section, the remote input parameters used to realize the 'virtual card holder' feature, which is the equivalent of the cardholder systems used in hotels, are mentioned. When you need to consider 2 adjacent rooms as separated or joined as if they were a single room (suite room) you can use remote inputs. To handle this situation both "Virtual Holder" modules of the 2 single rooms must be activated and configured. The principle is to connect the sensors (door or presence) of room 1 to room 2 and vice versa; however, the "Subordinate to Remote Inputs Enable" parameter for every single Remote Input should be properly configured.

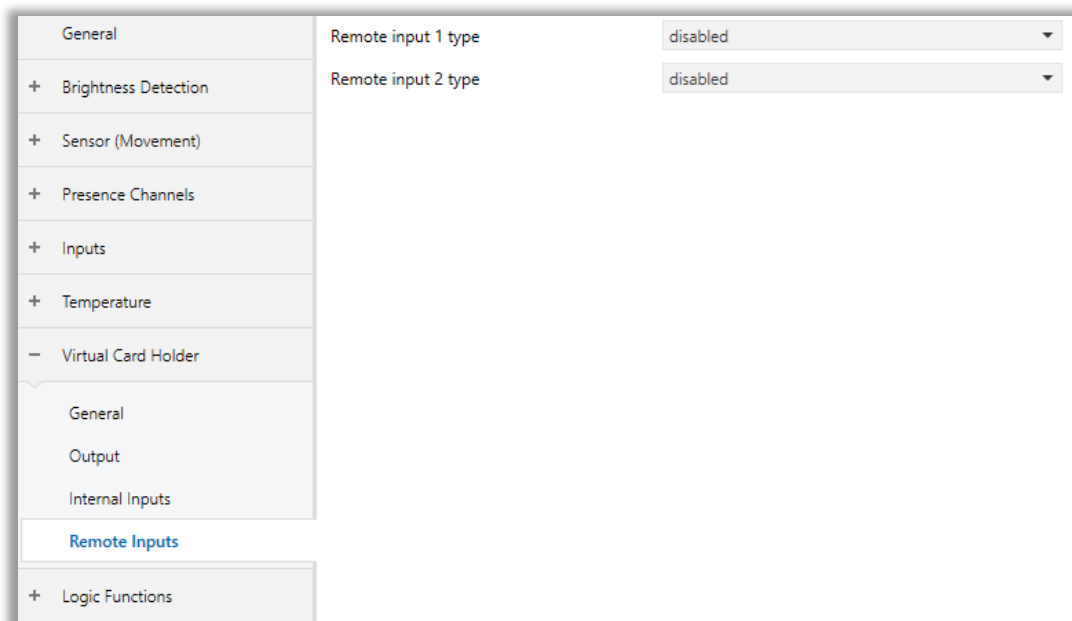


Fig. 32 : Virtual Card Holder – Remote Input

3.7.4.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Remote input type 1	<p>This parameter is used to enable or disable the remote input type 1. If it is selected as disabled, there will be no input 1.</p> <p>Door : The remote input is connected to door contact.</p> <p>Presence Sensor : The remote input is connected to the presence sensor.</p>	<p>Disabled</p> <p>Door</p> <p>Presence Sensor</p>
-> Subordinate to remote input enables	<p>This parameter is used to determine the subordinate or not subordinate relation of the related room.</p> <p>For sensors located in Room 1, this parameter must be set to "not subordinate" on room 1 "Virtual Holder" while should be "subordinated" to room 2 Virtual Holder The same principle must be applied to room 2 sensors that are "subordinate" only for the connections to room 1.</p>	<p>Not subordinate</p> <p>Subordinate</p>
Remote input type 2	<p>This parameter is used to enable or disable the remote input type 2. If it is selected as disabled, there will be no input 2.</p> <p>Door : The remote input is connected to door contact.</p> <p>Presence Sensor : The remote input is connected to the presence sensor.</p>	<p>Disabled</p> <p>Door</p> <p>Presence Sensor</p>
-> Subordinate to remote input enables	<p>This parameter is used to determine the subordinate or not subordinate relation of the related room.</p> <p>For sensors located in Room 1, this parameter must be set to "not subordinate" on room 1 "Virtual Holder" while should be "subordinated" to room 2 Virtual Holder The same principle must be applied to room 2 sensors that are "subordinate" only for the connections to room 1.</p>	<p>Not subordinate</p> <p>Subordinate</p>

3.8. Logic Functions

This section describes the logical function modules of the Interra KNX presence sensor. With the logical function blocks on the KNX presence sensor, a logical expression can be created with the ambient temperature, the brightness level of the environment, whether there is a presence detection in the environment, the data coming through the local digital inputs or external inputs, and various 'TRUE' or 'FALSE' results can be obtained. actions can be taken and scenarios can be triggered.

3.8.1. Logic Functions – General

This section describes the general parameters of the logical association module of the Interra KNX presence sensor. Parameters must be configured separately for each logic block.

General	Use logic function	<input type="radio"/> no <input checked="" type="radio"/> yes
+ Brightness Detection	Result of logic function	
+ Sensor (Movement)	Logic function	AND
+ Presence Channels	Result of logic inverted	<input checked="" type="radio"/> no <input type="radio"/> yes
+ Inputs	Logic result send status	status changed
+ Temperature		
+ Virtual Card Holder		
- Logic Functions		
+ Logic 1		
Logic 2		
Logic 3		
Logic 4		
Logic 5		

Fig. 33 : Logic Functions – General

3.8.1.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Use Logic Function	This parameter is used to enable or disable the related logic function gate.	No Yes
Logic Function	This parameter is used to determine the logical relation of the parameterized logic inputs. AND: All inputs are put into the 'AND' operation. OR: All inputs are put into the 'OR' operation. XOR: All inputs are put into the 'XOR' operation.	AND OR XOR
Result of Logic Inverted	This parameter is used to invert or not invert the calculated logic function block. If it is selected as yes for example, when the logic function gate output is 'TRUE', the output will be 'FALSE'. Vice versa also applies.	No Yes
Logic result send status	This parameter is used to determine the logic function block result sending status to the KNX bus.	Status changed Status is TRUE Status is FALSE Status changed and periodically Status is TRUE periodically Status is FALSE periodically

3.8.2. Logic Functions - Input

This section describes the input parameters of the logical association module of the Interra KNX presence sensor.

Parameters must be configured separately for each logic block.

The screenshot displays the configuration interface for the Interra KNX presence sensor. On the left, a sidebar menu shows the following options: General, Brightness Detection, Sensor (Movement), Presence Channels, Inputs, Temperature, Virtual Card Holder, Logic Functions, Logic 1, Input (highlighted), Output, Lock, Logic 2, Logic 3, Logic 4, and Logic 5. The main configuration area is titled 'Logic 1' and contains the following settings:

Enable movement sensor	<input type="text" value="disable movement"/>
Enable brightness sensor	<input type="text" value="disable brightness"/>
Enable temperature sensor	<input type="text" value="disable temperature"/>
Enable input 1	<input checked="" type="radio"/> disable <input type="radio"/> enable
Enable input 2	<input checked="" type="radio"/> disable <input type="radio"/> enable

Fig. 34 : Logic Functions – Input

3.8.2.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Enable Movement Sensor	This parameter is used to enable or disable the movement sensor: Internal movement: The internal movement sensor will be used as movement logic input. External movement: The external movement information will be used for movement detection.	Disable movement Internal movement External movement
-> Internal Movement Sensor Status	This parameter is used to determine when the internal movement sensor detects a movement is accounted as TRUE or FALSE.	Movement sensor detected is FALSE else is TRUE Movement sensor detected is TRUE else is FALSE
Enable Brightness Sensor	This parameter is used to enable or disable the brightness sensor. Internal Brightness : The internal brightness sensor will be used as brightness logic input. External Brightness : The external brightness sensor will be used as brightness logic input.	Disable Brightness Internal Brightness External Brightness
-> Threshold brightness lower	This parameter is used to determine the lower threshold brightness value.	1... 100 ...1200
-> Threshold brightness upper	This parameter is used to determine the upper threshold brightness value.	1... 300 ...1200
-> Brightness status	This parameter is used to determine when the ambient brightness value is accounted as TRUE or FALSE.	In range is TRUE, else FALSE Out range is TRUE, else FALSE Under lower is TRUE, above upper is FALSE Under lower is FALSE, above upper is TRUE
-> Change brightness threshold via bus	This parameter is used to change the brightness threshold value via a KNX bus object.	No yes

Enable Temperature Sensor	<p>This parameter is used to enable or disable the temperature sensor.</p> <p>Temperature: The temperature chosen in the sensor's temperature function.</p> <p>KNX temperature: The external temperature sensor will be used as temperature logic input.</p>	<p>Disable Temperature</p> <p>Internal temperature</p> <p>External temperature</p>
-> Threshold temperature upper	This parameter is used to determine the lower threshold temperature value.	-300...260...700
-> Threshold temperature lower	This parameter is used to determine the upper threshold temperature value.	-300...220...700
-> Temperature status	This parameter is used to determine when the ambient temperature value is accounted as TRUE or FALSE.	<p>In range is TRUE, else FALSE</p> <p>Out range is TRUE, else FALSE</p> <p>Under lower is TRUE, above upper is FALSE</p> <p>Under lower is FALSE, above upper is TRUE</p>
-> Change temperature threshold via bus	This parameter is used to change the temperature threshold value via a KNX bus object.	<p>No</p> <p>yes</p>
Enable Input 1	This parameter is used to enable or disable input 1 for logic function block as input	<p>Disable</p> <p>enable</p>
-> Select Input Source	This parameter is used to determine the input source as an internal or external object.	<p>External object</p> <p>Internal object</p>
->> Contact Input Status	This parameter is used to determine when a press occurs on the local input is accounted as TRUE or FALSE.	<p>Pressed TRUE else FALSE</p> <p>Pressed FALSE else TRUE</p>
->> External input type	This parameter is used to determine the external input type of the enabled input 1 object.	<p>1-bit value('1'/'0')</p> <p>1-byte value(0...255)</p>

		2-byte threshold(0...65535) 2-byte float threshold(-50C...100C) 4-byte threshold(0...4294967295)
->> External input status	This parameter is used to determine the input status as TRUE or FALSE according to the value. (This is visible if the input is selected as 1 bit)	'1' is TRUE, '0' is FALSE '1' is FALSE, '0' is TRUE
->> External Input value	This parameter is used to determine the external input threshold value to evaluate the input status as TRUE or FALSE.	0...100...255 0...1000...65535 -500...0...1000 0...10000...4294967295
->> External input status	This parameter is used to determine the input status as TRUE or FALSE according to the value. (This is visible if the input is not selected as 1 bit)	TRUE if input value >= threshold else FALSE TRUE if input value <= threshold else FALSE
->> Default status after bus voltage recovery	This parameter is used to determine the logic status after bus voltage recovery.	False True recovery
Enable Input 2	This parameter is used to enable or disable input 2 for logic function block as input	Disable enable
-> Select Input Source	This parameter is used to determine the input source as an internal or external object.	External object Internal object
->> Contact Input Status	This parameter is used to determine when a press occurs on the local input is accounted as TRUE or FALSE.	Pressed TRUE else FALSE Pressed FALSE else TRUE

->> External input type	This parameter is used to determine the external input type of the enabled input 2 object.	1-bit value('1'/'0') 1-byte value(0..255) 2-byte threshold(0...65535) 2-byte float threshold(-50C...100C) 4-byte threshold(0...4294967295)
->> External input status	This parameter is used to determine the input status as TRUE or FALSE according to the value. (This is visible if the input is selected as 1 bit)	'1' is TRUE, '0' is FALSE '1' is FALSE, '0' is TRUE
->> External Input value	This parameter is used to determine the external input threshold value to evaluate the input status as TRUE or FALSE.	0... 100 ...255 0... 1000 ...65535 -500... 0 ...1000 0... 10000 ...4294967295
->> External input status	This parameter is used to determine the input status as TRUE or FALSE according to the value. (This is visible if the input is not selected as 1 bit)	TRUE if input value >= threshold else FALSE TRUE if input value <= threshold else FALSE
->> Default status after bus voltage recovery	This parameter is used to determine the logic status after bus voltage recovery.	False True recovery

3.8.3. Logic Functions – Output General

This section describes the general parameters of the logic output functions. The property of each respective output channel is set by configuring the parameters in this section. Also, repetitive sending of output values can be set here.

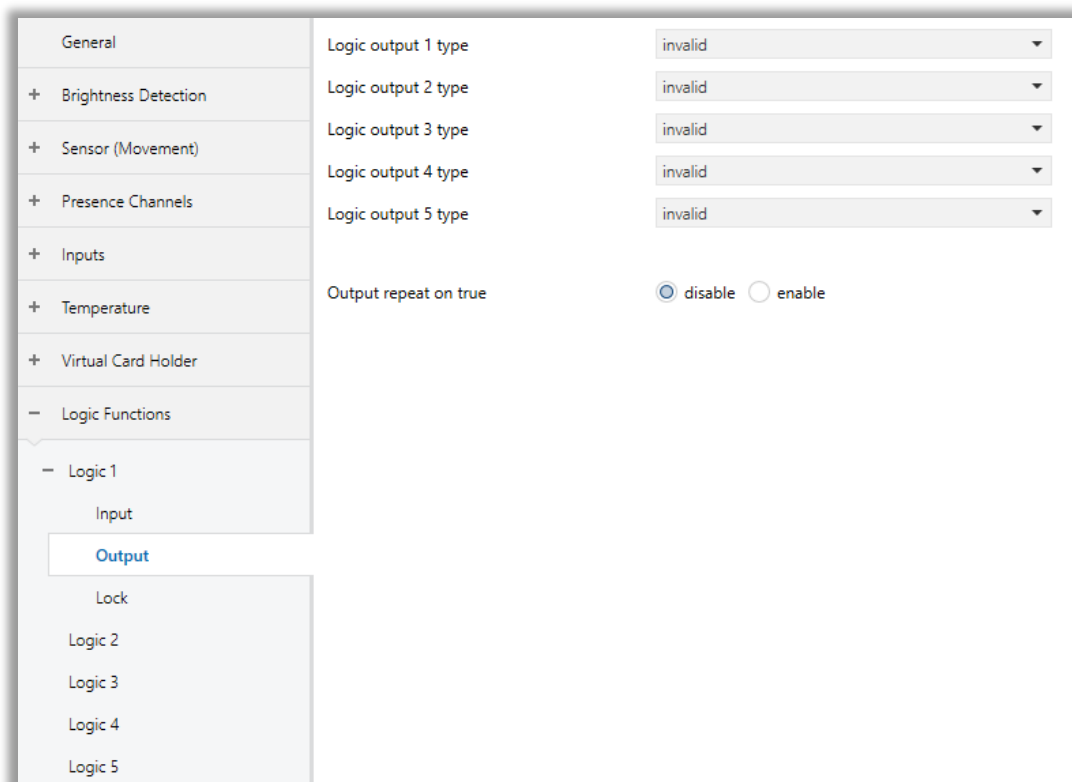


Fig. 35 : Logic Functions – Output General

3.8.3.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Logic Output X type (1...5)	<p>This parameter is used to specify the related logic output x channel functionality.</p> <p>If this parameter is selected as invalid, the related output channel will not be used. Other selected options will be configured separately.</p>	<p>Invalid</p> <ul style="list-style-type: none"> Switch controller Absolute dimming controller Shutter controller Alarm controller Percentage control. Sequence control. Scene controller String controller Threshold controller
Output repeat on true	<p>This parameter is used to enable or disable the output repeating time for all output channels when the logic gate state is true.</p>	<p>On telegram</p> <p>Off telegram</p>
-> Repeated time interval	<p>This parameter is used to determine the repeated time for all enabled output channels to send output channel values when the logic gate state is true.</p>	0... 120 ...65535

3.8.4. Logic Functions – Outputs 1-5

This section describes parameter configurations for each logic output channel. Although the working principle is the same for all output channels, only the type of values to be sent changes depending on the selected output functionality. For this reason, parameters are described in a common table about only one feature.

General	The status after bus voltage recovery	invalid
+ Brightness Detection	Send output object when TRUE	<input type="radio"/> no <input checked="" type="radio"/> yes
+ Sensor (Movement)	Defined output value	100% (255)
+ Presence Channels	On delay time	00:00:00 hh:mm:ss
+ Inputs	Change on time via bus	<input checked="" type="radio"/> no <input type="radio"/> yes
+ Temperature	Send output object when FALSE	<input type="radio"/> no <input checked="" type="radio"/> yes
+ Virtual Card Holder	Defined output value	0% (OFF)
- Logic Functions	On delay time	00:00:00 hh:mm:ss
- Logic 1	Change on time via bus	<input checked="" type="radio"/> no <input type="radio"/> yes
Input		
- Output		
1 - Dimming		
Lock		
Logic 2		
Logic 3		
Logic 4		
Logic 5		

Fig. 36 : Logic Functions – Output: Dimming

3.8.4.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
The status after bus voltage recovery	This parameter is used to determine the logic output channel x status after bus voltage recovery.	invalid Recovery Defined
-> Recovery Defined Value	This parameter is used to determine the output channel x value when the bus voltage has been recovered.	On...Off %0...%100 Up...Down No alarm...alarm Stop...start Scene no.1...scene no64 14 bytes string 0... 1000 ...65535
Send output object when TRUE	This parameter is used to enable or disable the sending output object when the logic gate is true.	No yes
-> Defined Output Value	This parameter is used to determine the logic output channel x defined value when the logic gate is true.	On...Off %0...%100 Up...Down No alarm...alarm Stop...start Scene no.1...scene no64 14 bytes string 0... 1000 ...65535
-> On Delay Time	This parameter is used to determine the on-delay time of the related logic output channel x when the logic gate is true.	00:00:00 ...18:12:15
-> Change on Time Via Bus	This parameter is used to enable or disable the on-delay time object for changing the delay time on the true state.	No yes
Send output object when FALSE	This parameter is used to enable or disable the sending output object when the logic gate is false.	No yes

<p>-> Defined Output Value</p>	<p>This parameter is used to determine the logic output channel x defined value when the logic gate is false.</p>	<p>On...Off %0...%100 Up...Down No alarm...alarm Stop...start Scene no.1...scene no64 14 bytes string 0...1000...65535</p>
<p>-> On Delay Time</p>	<p>This parameter is used to determine the on-delay time of the related logic output channel x when the logic gate is false.</p>	<p>00:00:00...18:12:15</p>
<p>-> Change on Time Via Bus</p>	<p>This parameter is used to enable or disable the on-delay time object for changing the delay time on the false state.</p>	<p>No yes</p>

3.8.5. Logic Functions – Lock

In this section, the locking feature of the logic functions is mentioned. The locking feature is for each logic function gate and is configured separately. Since there are 5 different logic function gates in the KNX sensor device, a separate configuration is required for each. Since the parameter page for each section is the same, only 1 is explained in this section.

General	Use logic lock	<input type="radio"/> no <input checked="" type="radio"/> yes
+ Brightness Detection	Telegram for lock activation	<input checked="" type="radio"/> ON telegram <input type="radio"/> OFF telegram
+ Sensor (Movement)	Automatic unlock after delay	<input checked="" type="radio"/> no <input type="radio"/> yes
+ Presence Channels	Feedback of logic function lock status	<input checked="" type="radio"/> no <input type="radio"/> yes
+ Inputs	After bus voltage recovery	<input checked="" type="radio"/> lock passive <input type="radio"/> lock active
+ Temperature		
+ Virtual Card Holder		
- Logic Functions		
- Logic 1		
Input		
+ Output		
Lock		
Logic 2		
Logic 3		
Logic 4		
Logic 5		

Fig. 37 : Logic Functions – Lock

3.8.5.1. Parameters List

PARAMETERS	DESCRIPTION	VALUES
Use Logic Lock	This parameter is used to lock the related logic function gate.	no yes
Telegram for Lock Activation	This parameter is used to determine the telegram value that locks the related logic function gate.	On telegram Off telegram
Automatic Unlock After Delay	This parameter is used to enable or disable the automatic unlock to unlock the logic gate after a while.	no yes
Automatic unlock time	This parameter is used to determine the automatically unlock period to unlock the logic function gate.	00:00:05... 00:00:30 ...18:12:15
Feedback of logic function lock status	This parameter is used to enable or disable the feedback of the logic lock status object.	No yes
After Bus Voltage Recovery	This parameter is used to determine the logic function gate lock status after the bus voltage recovery.	Lock Passive Lock Active

4. ETS Objects List & Descriptions

The Interra KNX Presence Sensors can communicate via the KNX bus line. In this section, the group objects of the Interra KNX Presence Sensors are described. All of the communication objects listed below are available to the presence detector. Which of these group objects are visible and capable of being linked with group addresses are explained in sub-sections.

No	Name	Function	DTP Type	Length	Flags				
					C	R	W	T	U
1	General	In operation	1.002	1 bit	X			X	
2	General	LED indicator	1.003	1 bit	X	X	X	X	
3	General	Movement Sensor 1	1.001	1 bit	X	X		X	
4	General	Movement Sensor 2	1.001	1 bit	X	X		X	
5	General	Movement Sensor 3	1.001	1 bit	X	X		X	
10	Input x: Switch function	Lock	1.003	1 bit	X		X		
	Input x: Switch/Dim function				X		X		
	Input x: Shutter function				X		X		
	Input x: Value/Forced op.				X		X		
	Input x: Scene function				X		X		
	Input x: RGB control				X		X		
11	Input x: Switch function	Switch	1.001	1 bit	X			X	X
	Input x: Switch/Dim function	Switch	1.001	1 bit	X			X	X
	Input x: Shutter function	Shutter Up/Down	1.008	1 bit	X		X	X	

	Input Value/Forced op. x:	Forced operation	2.001	2 bit	X		X	
	Input Value/Forced op. x:	Percent value	5.001	1 byte	X		X	
	Input Value/Forced op. x:	Decimal value	5.005	1 byte	X		X	
	Input Value/Forced op. x:	Scene	17.001	1 byte	X		X	
	Input Value/Forced op. x:	Colour temperature	7.600	2 bytes	X		X	
	Input Value/Forced op. x:	Temperature value	9.001	2 bytes	X		X	
	Input Value/Forced op. x:	Brightness value	9.004	2 bytes	X		X	
	Input Value/Forced op. x:	Percent value	232.600	3 bytes	X		X	
	Input x: Control scene	8-bit Scene	18.001	1 byte	X		X	
	Input x: RGB colour control	Red colour	5.010	1 byte	X	X	X	
		RGB colour	232.600	3 bytes				
12	Input x: Switch function	Switch-long	1.001	1 bit	X		X	
	Input Switch/Dim function x:	Dimming	3.007	4 bit	X		X	
	Input x: Shutter function	Stop/lamella adjustment	1.007	1 bit	X		X	
	Input Value/Forced op. x:	Forced operation	2.001	2 bit	X		X	
	Input Value/Forced op. x:	Percent value	5.001	1 byte	X		X	

	Input Value/Forced op. x:	Decimal value	5.005	1 byte	X			X	
	Input Value/Forced op. x:	Scene	17.001	1 byte	X			X	
	Input Value/Forced op. x:	Colour temperature	7.600	2 bytes	X			X	
	Input Value/Forced op. x:	Temperature value	9.001	2 bytes	X			X	
	Input Value/Forced op. x:	Brightness value	9.004	2 bytes	X			X	
	Input Value/Forced op. x:	Percent value	232.600	3 bytes	X			X	
	Input x: Scene function	Store scene	1.003	1 bit	X		X	X	
	Input x: RGB control	Green colour	5.010	1 byte	X	X		X	
13	Input x: Shutter function	Upper limit position	1.002	1 bit	X		X		
	Input x: RGB control	Blue colour	5.010	1 byte	X	X		X	
14	Input x: Shutter function	Lower limit position	1.002	1 bit	X		X		
15-19	Input a...b								
20	Additional Prob	Lock	1.003	1 bit	X		X		
21	Additional Prob	Temperature	9.001	2 bytes	X	X		X	
25	Brightness	Measured value	9.004	2 bytes	X	X		X	
26	Brightness	Calibration value	9.004	2 bytes	X		X		
27	Sensor	Lock	1.003	1 bit	X		X		
28	Sensor	Presence output	1.001	1 bit	X		X	X	X
			5.001	1 byte					
29	Sensor	Light-on time	7.005	2 bytes	X		X		X
30	Sensor	External Movement(Slave)	1.001	1 bit	X		X		X

31	Sensor	External brightness	9.004	2 bytes	X	X		X
32	Sensor	Brightness-value threshold	9.004	2 bytes	X	X	X	X
33	Presence 1	Lock	1.003	1 bit	X	X		X
34	Presence 1	Presence output	1.001	1 bit	X	X	X	X
			5.001	1 byte				
35	Presence 1	Light-on time	7.005	2 bytes	X	X		X
36	Presence 1	External movement	1.001	1 bit	X	X		
37	Presence 1	External brightness	9.004	2 bytes	X	X		
38	Presence 1	Brightness-value threshold	9.004	2 bytes	X	X	X	X
39	Presence 1	Manual on/off	1.001	1 bit	X	X		X
40	Presence 1	Relative dimming	3.007	4 bit	X	X		X
41	Presence 1	Absolute dimming	5.001	1 byte	X	X		X
42	Presence 1	Status of control	1.001	1 bit	X	X		X
43	Presence 1	Forced operation	1.010	1 bit	X	X	X	
			2.001	2 bit	X	X	X	
44	Presence 1	Forced operation value	5.001	1 byte	X	X	X	X
45-84	Presence 2...4							
85	Temperature	Alarm	1.005	1 bit	X	X		X
86	Temperature	Actual Temperature	9.001	2 bytes	X	X		X
87	Temperature	KNX Probe Temperature	9.001	2 bytes	X	X		
88	Virtual Holder	Room Booked	1.002	1 bit	X	X		
89	Virtual Holder	Presence Output	1.002	1 bit	X	X		X
90	Virtual Holder	Unexpected Presence	1.005	1 bit	X			X
91	Virtual Holder	HVAC Output	20.102	1 byte	X	X		X
92	Virtual Holder	Additional Output	5.010	1 byte	X			X
93	Virtual Holder	Remote Input 1	1.002	1 bit	X	X		
94	Virtual Holder	Remote Input 2	1.002	1 bit	X	X		
95	Logic x:	Lock function	1.003	1 bit	X	X		
96	Logic x:	Feedback of lock	1.003	1 bit	X	X		X
97	Logic x: Input	External movement	1.001	1 bit	X	X	W	
98	Logic x: Input	External brightness	9.004	2 bytes	X	X	X	X
99	Logic x: Input	Brightness threshold lower	9.004	2 bytes	X	X	X	X
100	Logic x: Input	Brightness threshold upper	9.004	2 bytes	X	X	X	X
101	Logic x: Input	External temperature	9.001	2 bytes	X	X		

102	Logic x: Input	Temperature threshold lower	9.001	2 bytes	X	X	X	X
103	Logic x: Input	Temperature threshold upper	9.001	2 bytes	X	X	X	X
104	Logic x: Input	External input-1 (1 bit)	1.001	1 bit	X	X		X
		External input-1 (1-byte threshold)	5.010	1 byte	X	X		X
		External input-1 (2 bytes threshold)	7.001	2 bytes	X	X		X
		External input-1 (2 bytes float threshold)	9.001	2 bytes	X	X		X
		External input-1 (4 bytes threshold)	12.001	4 bytes	X	X		X
105	Logic x: Input	External input-2 (1 bit)	1.001	1 bit	X	X		X
		External input-2 (1-byte threshold)	5.010	1 byte	X	X		X
		External input-2 (2 bytes threshold)	7.001	2 bytes	X	X		X
		External input-2 (2 bytes float threshold)	9.001	2 bytes	X	X		X
		External input-2 (4 bytes threshold)	12.001	4 bytes	X	X		X
107	Logic x: Output	Result status	1.002	1 bit	X		X	
108	Logic x: Output: y	Switching	1.001	1 bit	X	X		X
		Absolute Dimming	5.001	1 byte	X	X		X
		Shutter	1.008	1 bit	X	X		X
		Alarm	1.005	1 bit	X	X		X
		Percentage	5.001	1 byte	X	X		X
		Sequence	1.010	1 bit	X	X		X
		Scene recall	17.001	1 byte	X	X		X
		String (14 bytes)	16.000	14 bytes	X	X		X
Threshold	7.001	2 bytes	X	X		X		
109	Logic x: Output: y	Delay time on the TRUE state	7.005	2 bytes	X		X	X
110	Logic x: Output: y	Delay time on FALSE state	7.005	2 bytes	X		X	X
110 - 153	Logic 2...5							

4.1. General Objects

This section describes the "general" group objects and their properties. General group objects, as the name suggests, indicate the general characteristics of the KNX Presence Sensor.

Object Name	Function	Type	Flags
General	In operation	1 bit	CT

This object is used to monitor the presence of the device on the KNX bus line regularly. However, monitoring telegrams can be sent cyclically on the KNX bus line.

DPT : 1.002 (boolean)

Object Name	Function	Type	Flags
General	LED Indicator	1 bit	CRWT

This object is used in place of the blue LED used to indicate that motion detection has occurred. When a motion in the detector's sensing angle is detected by the sensor, a 1-bit telegram is sent over this object. This object is usually used during installation to quickly and easily determine the detection range of the sensor.

DPT : 1.003 (enable)

4.2. Brightness Objects

This section describes the "brightness" group objects and their properties. Brightness group objects, as the name suggests, indicates the brightness configuration of the KNX Presence Sensor. Brightness sensor objects are directly related to both the sensor and presence channels.

Object Name	Function	Type	Flags
Brightness	Measured value	2 bytes	CRT

This object is used to send the values measured by the brightness sensor on the detector to the KNX bus line. Depending on the parameter configuration, the measured data can be sent to the bus line periodically or according to the amount of change.

Note: Brightness sensor calibration is required for the measurements to be healthier and more accurate.

DPT : 9.004 (lux)

Brightness	Calibration Value	2 bytes	CW
------------	-------------------	---------	----

This object is used for brightness sensor calibration. In general, sensor calibration is required to accurately measure the ambient brightness by the detector. In the environment where the sensor is installed, a suitable reference point is selected (for example, right under the sensor) and the ambient brightness is measured with a lux meter. Then, the measured value is sent to this calibration object as the value and the calibration process is completed.

DPT : 9.004 (lux)

4.3. Sensor

This section contains information about KNX objects and their properties related to the sensor channel. The types, flags and properties of the objects are explained in detail below.

Object Name	Function	Type	Flags
Sensor	Lock	1 bit	CW

This object is used to lock the sensor channel. It becomes visible when the "use sensor lock" parameter is set to yes. Depending on the parameter setting, when an ON or OFF telegram is sent to this object, the corresponding presence channel is locked.

For example, when "ON telegram" is selected in the parameter page for locking, it will be locked when an ON telegram is received from the KNX bus line, and when an OFF telegram is received, the sensor channel will be unlocked. Depending on the parameter configuration, an output value can also be sent when the locking operation is performed.

DPT : 1.003 (enable)

Sensor	Presence output	1 bit 1 byte	CWTU
--------	-----------------	-----------------	------

This object is used to determine the output value of the sensor channel. The parameterized value during movement is sent to the actuator via the output when the parameterized brightness threshold including the hysteresis is exceeded or falls short. The value set in the "value for switch on" parameter is sent to the KNX bus line when detection occurs. After the detection process is finished (i.e., after the light-on time expires), the "value for switch off" value is sent to the KNX bus line.

If the "detection independent of brightness" parameter is set to yes, the output value is sent to the KNX bus line when a motion is detected regardless of the ambient brightness.

DPT : 1.001 (switch), 5.001 (percentage)

Sensor	Light-on time	2 bytes	CWU
--------	---------------	---------	-----

This object is used to change the duration of the sensor channel light-on time. The light-on time is the time between the end of motion detection and the sending of the telegram "Value for switch off". If movement is detected again within this period, the light-on time timer is started again. When a 2-byte time value is sent from the KNX bus line, this sent value will be used instead of the light-on time set via the parameter. Until a new time value is sent to this object, the last value sent will be used as the light-on period.

Note : The values which can be sent are between **10-65535** seconds. If a value that is too small or too large is sent, the value is automatically adjusted to the limit value.

DPT : 7.005 (time)

Sensor	Slave input	1 bit	CWU
--------	-------------	-------	-----

This object is used to obtain presence information from detectors set as slaves. When the ON telegram comes to this object over the KNX bus line, the master detector decides 'motion detected' and takes the necessary actions. Typically, the output object of the detectors set as the slave is connected to the slave input object of the master detector. With this method, the detection area to be controlled can be expanded.

DPT : 1.001 (switch)

Sensor	External brightness	2 bytes	CWU
--------	---------------------	---------	-----

This object is used to send the brightness value to the detector's sensor channel via external sources. The value read on this object is compared with the brightness value threshold and operations are performed by the detector. For instance, if the brightness value is higher or lower than the hysteresis band, the detector will switch the lights.

Note: If the brightness value will be used over external sources, it is recommended to send the ambient brightness values to this object periodically so that the detector can make accurate evaluations.

DPT : 9.004 (lux)

Sensor	Brightness-value threshold	2 bytes	CRWTU
--------	----------------------------	---------	-------

This object is used to change the switching threshold for the sensor channel, at which the detector is activated. The value is sent to this object in lux. This value is used as the new switching threshold. The current switching threshold can be read via this communication object. Until a new brightness threshold value is sent to this object, the last value sent will be used as the brightness-value threshold.

Note : The values which can be sent are between **1-1200** lux. If a value that is too small or too large is sent, the value is automatically adjusted to the limit value.

DPT : 9.004 (lux)

4.4. Presence

This section contains information about KNX objects and their properties related to the sensor channel. The types, flags and properties of the objects are explained in detail below. There are 4 presence channels with identical features in the KNX presence sensor. For this reason, only objects for presence 1 channel are described in this section. These objects and their descriptions can be referenced when the other channels will be used.

Object Name	Function	Type	Flags
Presence 1	Lock	1 bit	CWU

This object is used to lock the presence channel. It becomes visible when the "use presence lock" parameter is set to yes. Depending on the parameter setting, when an ON or OFF telegram is sent to this object, the corresponding presence channel is locked.

For example, when "ON telegram" is selected in the parameter page for locking, it will be locked when an ON telegram is received from the KNX bus line, and when an OFF telegram is received, the presence channel will be unlocked. Depending on the parameter configuration, an output value can also be sent when the locking operation is performed.

DPT : 1.003 (enable)

Presence 1	Presence output	1 bit 1 byte	CWTU
------------	-----------------	-----------------	------

This object is used to determine the output value of the present channel. The parameterized value during movement is sent to the actuator via the output when the parameterized brightness threshold including the hysteresis is exceeded or falls short. The value set in the "value for switch on" parameter is sent to the KNX bus line when detection occurs. After the detection process is finished (i.e., after the light-on time expires), the "value for switch off" value is sent to the KNX bus line.

If the application is selected as Constant Light Switch and If the "detection independent of brightness" parameter is set to yes, the output value is sent to the KNX bus line when a motion is detected regardless of the ambient brightness.

If the Application Constant Light Controller is selected and the "Presence depending" parameter is set to no, the output value according to the brightness threshold is sent to the KNX bus line regardless of motion detection.

DPT : 1.001 (switch), 5.001 (percentage)

Presence 1	Light-on time	2 bytes	CWU
------------	---------------	---------	-----

This object is used to change the duration of the presence channel light-on time. The light-on time is the period between the end of motion detection and the sending of the telegram "Value for switch off". If movement is detected again within this period, the light-on time timer is started again. When a 2-byte time value is sent from the KNX bus line, this sent value will be used instead of the light-on time set via the parameter. Until a new time value is sent to this object, the last value sent will be used as the light-on period.

Note : The values which can be sent are between **10-65535** seconds. If a value that is too small or too large is sent, the value is automatically adjusted to the limit value.

DPT : 7.005 (time)

Presence 1	External movement	1 bit	CW
------------	-------------------	-------	----

This object is used to inform the detector by external sources that a movement has occurred in the environment to be controlled by the detector. For this object to be visible, the "used movement detection" parameter must be selected "internal and external". When the ON telegram comes to this object from the KNX bus line, the detector determines motion detection and performs the relevant actions.

For instance, this object can be used when detectors are installed that will operate as a master-slave in the same environment. Typically, the output of sensors operating in slave mode is connected to this object of the sensor operating in master mode. Thus, the detection distance to be controlled is extended.

DPT : 1.001 (switch)

Presence 1	External brightness	2 bytes	CW
------------	---------------------	---------	----

This object is used to send the brightness value to the detector's related presence channel via external sources. The value read on this object is compared with the brightness value threshold and operations are performed by the detector. For instance, if the brightness value is higher or lower than the hysteresis band, the detector will be dim or switch the lights (according to application : constant light control or constant light switch).

Note: If the brightness value will be used over external sources, it is recommended to send the ambient brightness values to this object periodically so that the detector can make accurate evaluations.

DPT : 9.004 (lux)

Presence 1	Brightness-value threshold	2 bytes	CRWTU
------------	----------------------------	---------	-------

This object is used to change the switching threshold for the related presence channel, at which the detector is activated. The value is sent to this object in lux. This value is used as the new switching threshold. The current switching threshold can be read via this communication object. Until a new brightness threshold value is sent to this object, the last value sent will be used as the brightness-value threshold.

Note : The values which can be sent are between **1-1200** lux. If a value that is too small or too large is sent, the value is automatically adjusted to the limit value.

DPT : 9.004 (lux)

Presence 1	Manual on/off	1 bit	CWU
------------	---------------	-------	-----

This object is used to dim the lights manually to on (value for switch on) and off (value for switch off) values. The object becomes visible when the "Enable 'Manual on/off' object" parameter in the input section of the presence page is selected as yes. When a telegram is sent to this object via the KNX bus, the constant light control will be disabled until the manual dim mode time expires. After the detector exits the manual mode, if there is no presence detection in the relevant environment, the value set in the "value for switch off" parameter is sent to the KNX bus line through the output object.

Note : The dimming operation will proceed according to the "Dimming time for manual from 0...%100 (0 = immediately)" parameter.

DPT : 1.001 (switch)

Presence 1	Relative dimming	4 bit	CWU
------------	------------------	-------	-----

This object is used to dim manually with the relative dim method. The object becomes visible when the "Enable 'Relative dimming' object" parameter in the input section of the presence page is selected as yes. When a telegram is sent to this object via the KNX bus, the constant light control will be disabled until the manual dim mode time expires. After the detector exits the manual mode, if there is no presence detection in the relevant environment, the value set in the "value for switch off" parameter is sent to the KNX bus line through the output object.

Possible object values : %1, %3, %6, %12, %25, %50, %100 (increase or decrease direction)

Note : The dimming operation will proceed according to the "Dimming time for manual from 0...%100 (0 = immediately)" parameter.

DPT : 3.007 (dimming control)

Presence 1	Absolute dimming	1 byte	CWU
------------	------------------	--------	-----

This object is used to dim manually with the absolute dim method. The object becomes visible when the "Enable 'Absolute dimming' object" parameter in the input section of the presence page is selected as yes. When a telegram is sent to this object via the KNX bus, the constant light control will be disabled until the manual dim mode time expires. After the detector exits the manual mode, if there is no presence detection in the relevant environment, the value set in the "value for switch off" parameter is sent to the KNX bus line through the output object.

Possible object values : %0...%100

Note : The dimming operation will proceed according to the "Dimming time for manual from 0...%100 (0 = immediately)" parameter.

DPT : 5.001 (percentage)

Presence 1	Status of control	1 bit	CRT
------------	-------------------	-------	-----

This object is used to detect whether the detector is operating in manual or automatic mode. During the mode transitions, the detector sends a telegram to the KNX bus line through this object. Sending an ON telegram to the KNX bus line means that the detector is in automatic mode, sending an OFF telegram means that the detector is in manual mode.

DPT : 1.001 (switch)

Presence 1	Forced operation	1 bit	CRWU
		2 bit	

This object is used to force the detector operating in constant light control mode out of this mode and to stay it at a constant output value. For example, when an ON telegram is sent to the object selected as 1 bit via KNX, the detector will exit the constant light control mode and transmit the value determined through the "Brightness value when forced activated" parameter to the output object and the detector switches to forced status. An OFF telegram must be sent to this object to activate the constant light control again and remove the detector from this forced state.

DPT : 1.010 (switch control), 2.001

Presence 1	Forced operation value	1 byte	CRWU
------------	------------------------	--------	------

This object is used to determine what the fixed output value will be when the detector is forced out of constant light control mode and remains at a constant output value. When a telegram is sent to this object via KNX, the new forcing state brightness value will now be this value instead of the value in the "Brightness value when forced activated" parameter. Until a new value is sent, the last sent value is used as the forced status constant output value.

DPT : 5.001 (percentage)

4.5. Inputs

This section contains information about KNX objects and their properties related to the input channels. The types, flags and properties of the objects are explained in detail below. There are 2 digital inputs channels with the same functionality and an additional probe channel. In this section, digital inputs objects are described only for one channel due to the identical.

Object Name	Function	Type	Flags
Input x	Lock	1 bit	CW

This object is used to lock the sensor channel. It becomes visible when the "use sensor lock" parameter is set to yes. Depending on the parameter setting, when an ON or OFF telegram is sent to this object, the corresponding presence channel is locked.

For example, when "ON telegram" is selected in the parameter page for locking, it will be locked when an ON telegram is received from the KNX bus line, and when an OFF telegram is received, the sensor channel will be unlocked. Depending on the parameter configuration, an output value can also be sent when the locking operation is performed.

DPT : 1.003

Input x: XXX function	YYY operation	1 bit / 2 bit / 1 byte / 2 byte / 3 byte / 4 byte	CT / CWT / CRT
-----------------------	---------------	---	----------------

This communication object changes in functionality depending on the selected input function. Depending on the configuration, the data type of this object changes. RGB colour value adjustment, switching, blind control, value/force value determination, scenario call operations can be performed on this object.

DPT : According to parameter selection

Input x: XXX function	YYY operation	1 bit / 1 byte / 2 byte / 3 byte	CW / CWT / CT / CRT
-----------------------	---------------	----------------------------------	---------------------

This communication object changes in functionality depending on the selected input function. Depending on the configuration, the data type of this object changes. Switching, dimming, lamella adjustment, scenario saving, RGB colour value adjustment, blind control, value/force value determination, scenario call operations can be performed on this object.

DPT : According to parameter selection

Input x: Shutter function /RGB control	Upper limit operation / Blue colour	1 bit / 1 byte	CWU
--	-------------------------------------	----------------	-----

This object is used to make upper limit operation for shutter usage or set blue colour setting. According to the input configuration on the ETS parameter page, the object usage changes. If the shutter function is selected, '0' is no upper limit operation, '1' upper-end operation. If the RGB control is selected, a 1-byte blue colour value is set via this object.

DPT : 1.001 / 5.010

Input x: Shutter function	Lower limit operation	1 bit	CWU
---------------------------	-----------------------	-------	-----

This object is used for the shutter actuator indicates if it is in the lower limit position ("shutter/blind closed"). The object is intended for a 1-button operation. '0' is no lower limit operation, '1' lower end operation.

Note: If the brightness value will be used over external sources, it is recommended to send the ambient brightness values to this object periodically so that the detector can make accurate evaluations.

DPT : 1.002

Additional Probe	Lock	1 bit	CW
------------------	------	-------	----

This object is used to lock the external probe that is connected to the analog input of the KNX presence sensor. According to the ETS parameter configuration, '1' or '0' values can lock or unlock the Additional Probe.

DPT : 1.003

Additional Probe	Temperature	2 bytes	CRT
------------------	-------------	---------	-----

This object is used to send temperature values to the KNX bus line. The temperature value can be also sent to the KNX bus line periodically or according to the configured variation parameter.

Note: For more accurate results, the NTC sensor parameter values and sensor calibration should be configured correctly

DPT : 9.001

4.6. Temperature

This section contains information about KNX objects and their properties related to the temperature channel. The types, flags and properties of the objects are explained in detail below.

Object Name	Function	Type	Flags
Temperature	Alarm	1 bit	CRT

This object is used to send the alarm temperature value calculated by the KNX Presence Sensor to the KNX bus line. Also, temperature measuring sources (internal, external and KNX) can be configured via ETS parameters.

Note: Temperature sensor calibration is required for the measurements to be healthier and more accurate.

DPT : 1.005

Temperature	Actual Temperature	2 bytes	CRT
-------------	--------------------	---------	-----

This object is used to send the actual temperature value calculated by the KNX Presence Sensor to the KNX bus line. Depending on the parameter configuration, the measured data can be sent to the bus line periodically or according to the amount of change. Also, temperature measuring sources can be configured via ETS parameters.

Note: Temperature sensor calibration is required for the measurements to be healthier and more accurate.

DPT : 9.001

Temperature	KNX Probe Temperature	2 bytes	CW
-------------	-----------------------	---------	----

This object is used to receive the temperature value from the KNX bus line. This value can be used as a single temperature source or mixing part for the temperature calculation by the KNX Presence sensor.

DPT : 9.001

4.7. Virtual Card Holder

This section contains information about KNX objects and their properties related to the virtual cardholder channel.

The types, flags and properties of the objects are explained in detail below.

Object Name	Function	Type	Flags
Virtual Holder	Room Booked	1 bit	CW

This object is used to receive the room booked information. By setting this communication object to “1” the status of the virtual holder is set to “room booked”; when set to “0” the status is “room not booked”. The virtual holder module can have different behaviour if the room is booked or not; the default value for this status can be set using the “Booked state after download” parameter.

DPT : 1.002

Virtual Holder: Output	Presence Output	1 bit	CRT
------------------------	-----------------	-------	-----

This object is used to receive the room booked information. By setting this communication object to “1” the status of the virtual holder is set to “room booked”; when set to “0” the status is “room not booked”. The virtual holder module can have different behaviour if the room is booked or not; the default value for this status can be set using the “Booked state after download” parameter.

DPT : 1.002

Virtual Holder: Output	Unexpected Presence	1 bit	CT
------------------------	---------------------	-------	----

This object is used to send “1” when the sensor detects an unexpected Presence.

DPT : 1.005

Virtual Holder: Output	Additional Output	1 byte	CT
------------------------	-------------------	--------	----

This object is used to send commands in event of presence and absence. Commands can be set different if the room is booked or not and if the person who enters the room is a guest, service or maintenance.

DPT : 5.010

Virtual Holder: Remote Input 1	Door / Presence	1 bit	CW
--------------------------------	-----------------	-------	----

This object is used when you need to consider 2 adjacent rooms as separated or joined as if they were a single room (suite room). This possibility must be considered during installation, so communication objects must be connected as described below if you want to switch runtime from one configuration (2 single rooms) to another (one double room) and vice versa.

Note : A Remote Input communication object (type door) must be connected only to one single door contact on/off a telegram.

A Remote Input communication object (type presence) must be connected only to one single device with a presence on/off a telegram.

DPT : 1.002

Virtual Holder: Remote Input 2	Door / Presence	1 bit	CW
--------------------------------	-----------------	-------	----

This object is used when you need to consider 2 adjacent rooms as separated or joined as if they were a single room (suite room). This possibility must be considered during installation, so communication objects must be connected as described below if you want to switch runtime from one configuration (2 single rooms) to another (one double room) and vice versa.

Note : A Remote Input communication object (type door) must be connected only to one single door contact on/off a telegram.

A Remote Input communication object (type presence) must be connected only to one single device with a presence on/off a telegram.

DPT : 1.002

4.8. Logic Function

This section contains information about KNX objects and their properties related to the logic function channels. The types, flags and properties of the objects are explained in detail below. There are 5 identical logic channels in the KNX Presence sensor, so only one logical channel is described here. The x values can be between 1...5 and y values also can be 1...5. Please do not forget to take this into account.

Object Name	Function	Type	Flags
Logic x:	Lock function	1 bit	CW

This object is used to lock the related logic channel x. It becomes visible when the "use logic lock" parameter is set to yes. Depending on the parameter setting, when an ON or OFF telegram is sent to this object, the corresponding logical channel is locked.

For example, when "ON telegram" is selected in the parameter page for locking, it will be locked when an ON telegram is received from the KNX bus line, and when an OFF telegram is received, the logic channel will be unlocked.

DPT : 1.003

Logic x:	Feedback of Lock	1 bit	CRT
----------	------------------	-------	-----

This object is used to send feedback on the lock status for the related logic channel x. It becomes visible when the "use logic lock" parameter is set to yes.

If a status change occurs on the lock function, the changed status value will be sent from this object.

DPT : 1.003

Logic x: Input	External movement	1 bit	CW
----------------	-------------------	-------	----

This object is used to receive movement information from the KNX bus line. According to the ETS parameter configuration, the '0' or '1' value is accounted as there is a movement detection occurs.

DPT : 1.001

Logic x: Input	External brightness	2 bytes	CWTU
----------------	---------------------	---------	------

This object is used to obtain a brightness value from the KNX bus line. The received brightness value will be used to evaluate the input status according to the brightness thresholds.

DPT : 9.004

Logic x: Input	Brightness threshold lower	2 bytes	CWTU
----------------	----------------------------	---------	------

This object is used to receive the brightness threshold lower value from the KNX bus line. The value read on this object is will be used as a new brightness threshold lower value. This object becomes visible when the "Change brightness threshold via bus" parameter is set to yes

Note : The values which can be sent are between **1-1200** lux. If a value that is too small or too large is sent, the value is automatically adjusted to the limit value.

DPT : 9.004

Logic x: Input	Brightness threshold upper	2 bytes	CWTU
----------------	----------------------------	---------	------

This object is used to receive the brightness threshold upper value from the KNX bus line. The value read on this object is will be used as a new brightness threshold upper value. This object becomes visible when the "Change brightness threshold via bus" parameter is set to yes

Note : The values which can be sent are between **1-1200** lux. If a value that is too small or too large is sent, the value is automatically adjusted to the limit value.

DPT : 9.004

Logic x: Input	External temperature	2 bytes	CW
----------------	----------------------	---------	----

This object is used to obtain temperature values from the KNX bus line. The received temperature value will be used to evaluate the input status according to the temperature thresholds.

DPT : 9.001

Logic x: Input	Temperature threshold lower	2 bytes	CWTU
----------------	-----------------------------	---------	------

This object is used to receive the temperature threshold lower value from the KNX bus line. The value read on this object is will be used as a new temperature threshold lower value. This object becomes visible when the "Change temperature via bus" parameter is set to yes

Note : The values which can be sent are between **-30 °C - 70 °C**. If a value that is too small or too large is sent, the value is automatically adjusted to the limit value.

DPT : 9.001

Logic x: Input	Temperature threshold upper	2 bytes	CWTU
----------------	-----------------------------	---------	------

This object is used to receive the temperature threshold upper value from the KNX bus line. The value read on this object is will be used as a new temperature threshold upper value. This object becomes visible when the "Change temperature via bus" parameter is set to yes

Note : The values which can be sent are between **-30 °C - 70 °C**. If a value that is too small or too large is sent, the value is automatically adjusted to the limit value.

DPT : 9.001

Logic x: Input	External input-1	1 bit / 1 byte / 2 byte / 4 byte	CWU
----------------	------------------	----------------------------------	-----

This object is used to obtain external input 1 information from the KNX bus line. According to the ETS parameter configuration, the received values are accounted as TRUE or FALSE for this external input. For 1 bit configuration, there is only '1' or '0' values for calculating the input status. But for other input (such as 1 byte, etc.) the received value is compared to the external input value parameter.

DPT : According to parameter selection, DPT changes.

Logic x: Input	External input-2	1 bit / 1 byte / 2 byte / 4 byte	CWU
----------------	------------------	----------------------------------	-----

This object is used to obtain external input 2 information from the KNX bus line. According to the ETS parameter configuration, the received values are accounted as TRUE or FALSE for this external input. For 1 bit configuration, there is only '1' or '0' values for calculating the input status. But for other input (such as 1 byte, etc.) the received value is compared to the external input value parameter.

DPT : According to parameter selection, DPT changes.

Logic x: Output	Result status	1 bit	CT
-----------------	---------------	-------	----

This object is used to send the related logic function block's result status to the KNX bus line. According to the ETS parameter configuration, this value can be sent periodically, on change or only configured value(TRUE or FALSE).

DPT : 1.002

Logic x: Output: y	Switch Threshold	1 bit / 1 byte / 2 bytes	CRT
--------------------	-----------------------	--------------------------	-----

This object is used to send the related output object's value to the KNX bus line. When the logic function block's status changes, the sending value also can be configured separately. In addition, according to the output type, the object's value type will be changed.

DPT : According to parameter selection

Logic x: Output: y	Delay time on the TRUE state	2 bytes	CWT
--------------------	------------------------------	---------	-----

This object is used to receive the 'delay time on TRUE state' value from the KNX bus line. When a new value is received from this object, the received value is used as the output on delay time for the TRUE state value. The configured parameter value will not be used anymore. This object becomes visible when the "Change on time via bus" parameter is set to yes

DPT : 7.005

Logic x: Output: y	Delay time on FALSE state	2 bytes	CWT
--------------------	---------------------------	---------	-----

This object is used to receive the 'delay time on FALSE state' value from the KNX bus line. When a new value is received from this object, the received value is used as the output on delay time for the FALSE state value. The configured parameter value will not be used anymore. This object becomes visible when the "Change on time via bus" parameter is set to yes

DPT : 7.005

CONTACT INFORMATION

THE INTERRA WEBSITE

Interra provides documentation support via our web site www.interratechnology.com. This website is used as a means to make files and information easily available to customers. Accessible by using your favourite Internet browser, the website contains the following information:

- Information about our products and projects.
- Overview of Interra company and values.
- Product Support: Datasheets, product manuals, application descriptions, latest software releases, ETS databases and archived software.

EUROPE, Turkey

Interra

Cumhuriyet mah. Kartal cad. Simkan Plaza No:95/1
Kartal/İstanbul

Tel: +90 (216) 326 26 40 Fax: +90 (216) 324 25 03

Web adress: <http://www.interratechnology.com>